
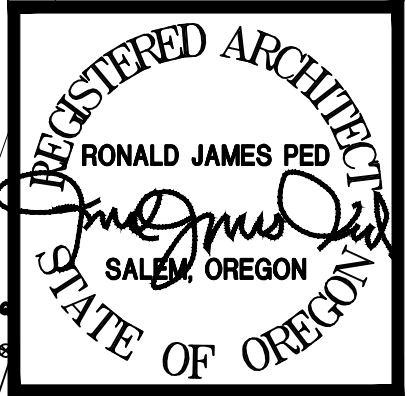


TABLE 610.4 235.5 WSFU @ OVER 60 PSI @ 215LF DEVELOPED LENGTH 1-1/2" METER WITH 2" BUILDING SUPPLY MAIN	FIRE FLOW 1320 SF x 32' HT = 42,240 SF/100 = 422.4 GPM x (3) BLDG = 1267 GPM
TABLE 703.2 222 DFU = USE 6" MAIN FOR 120 DFU	

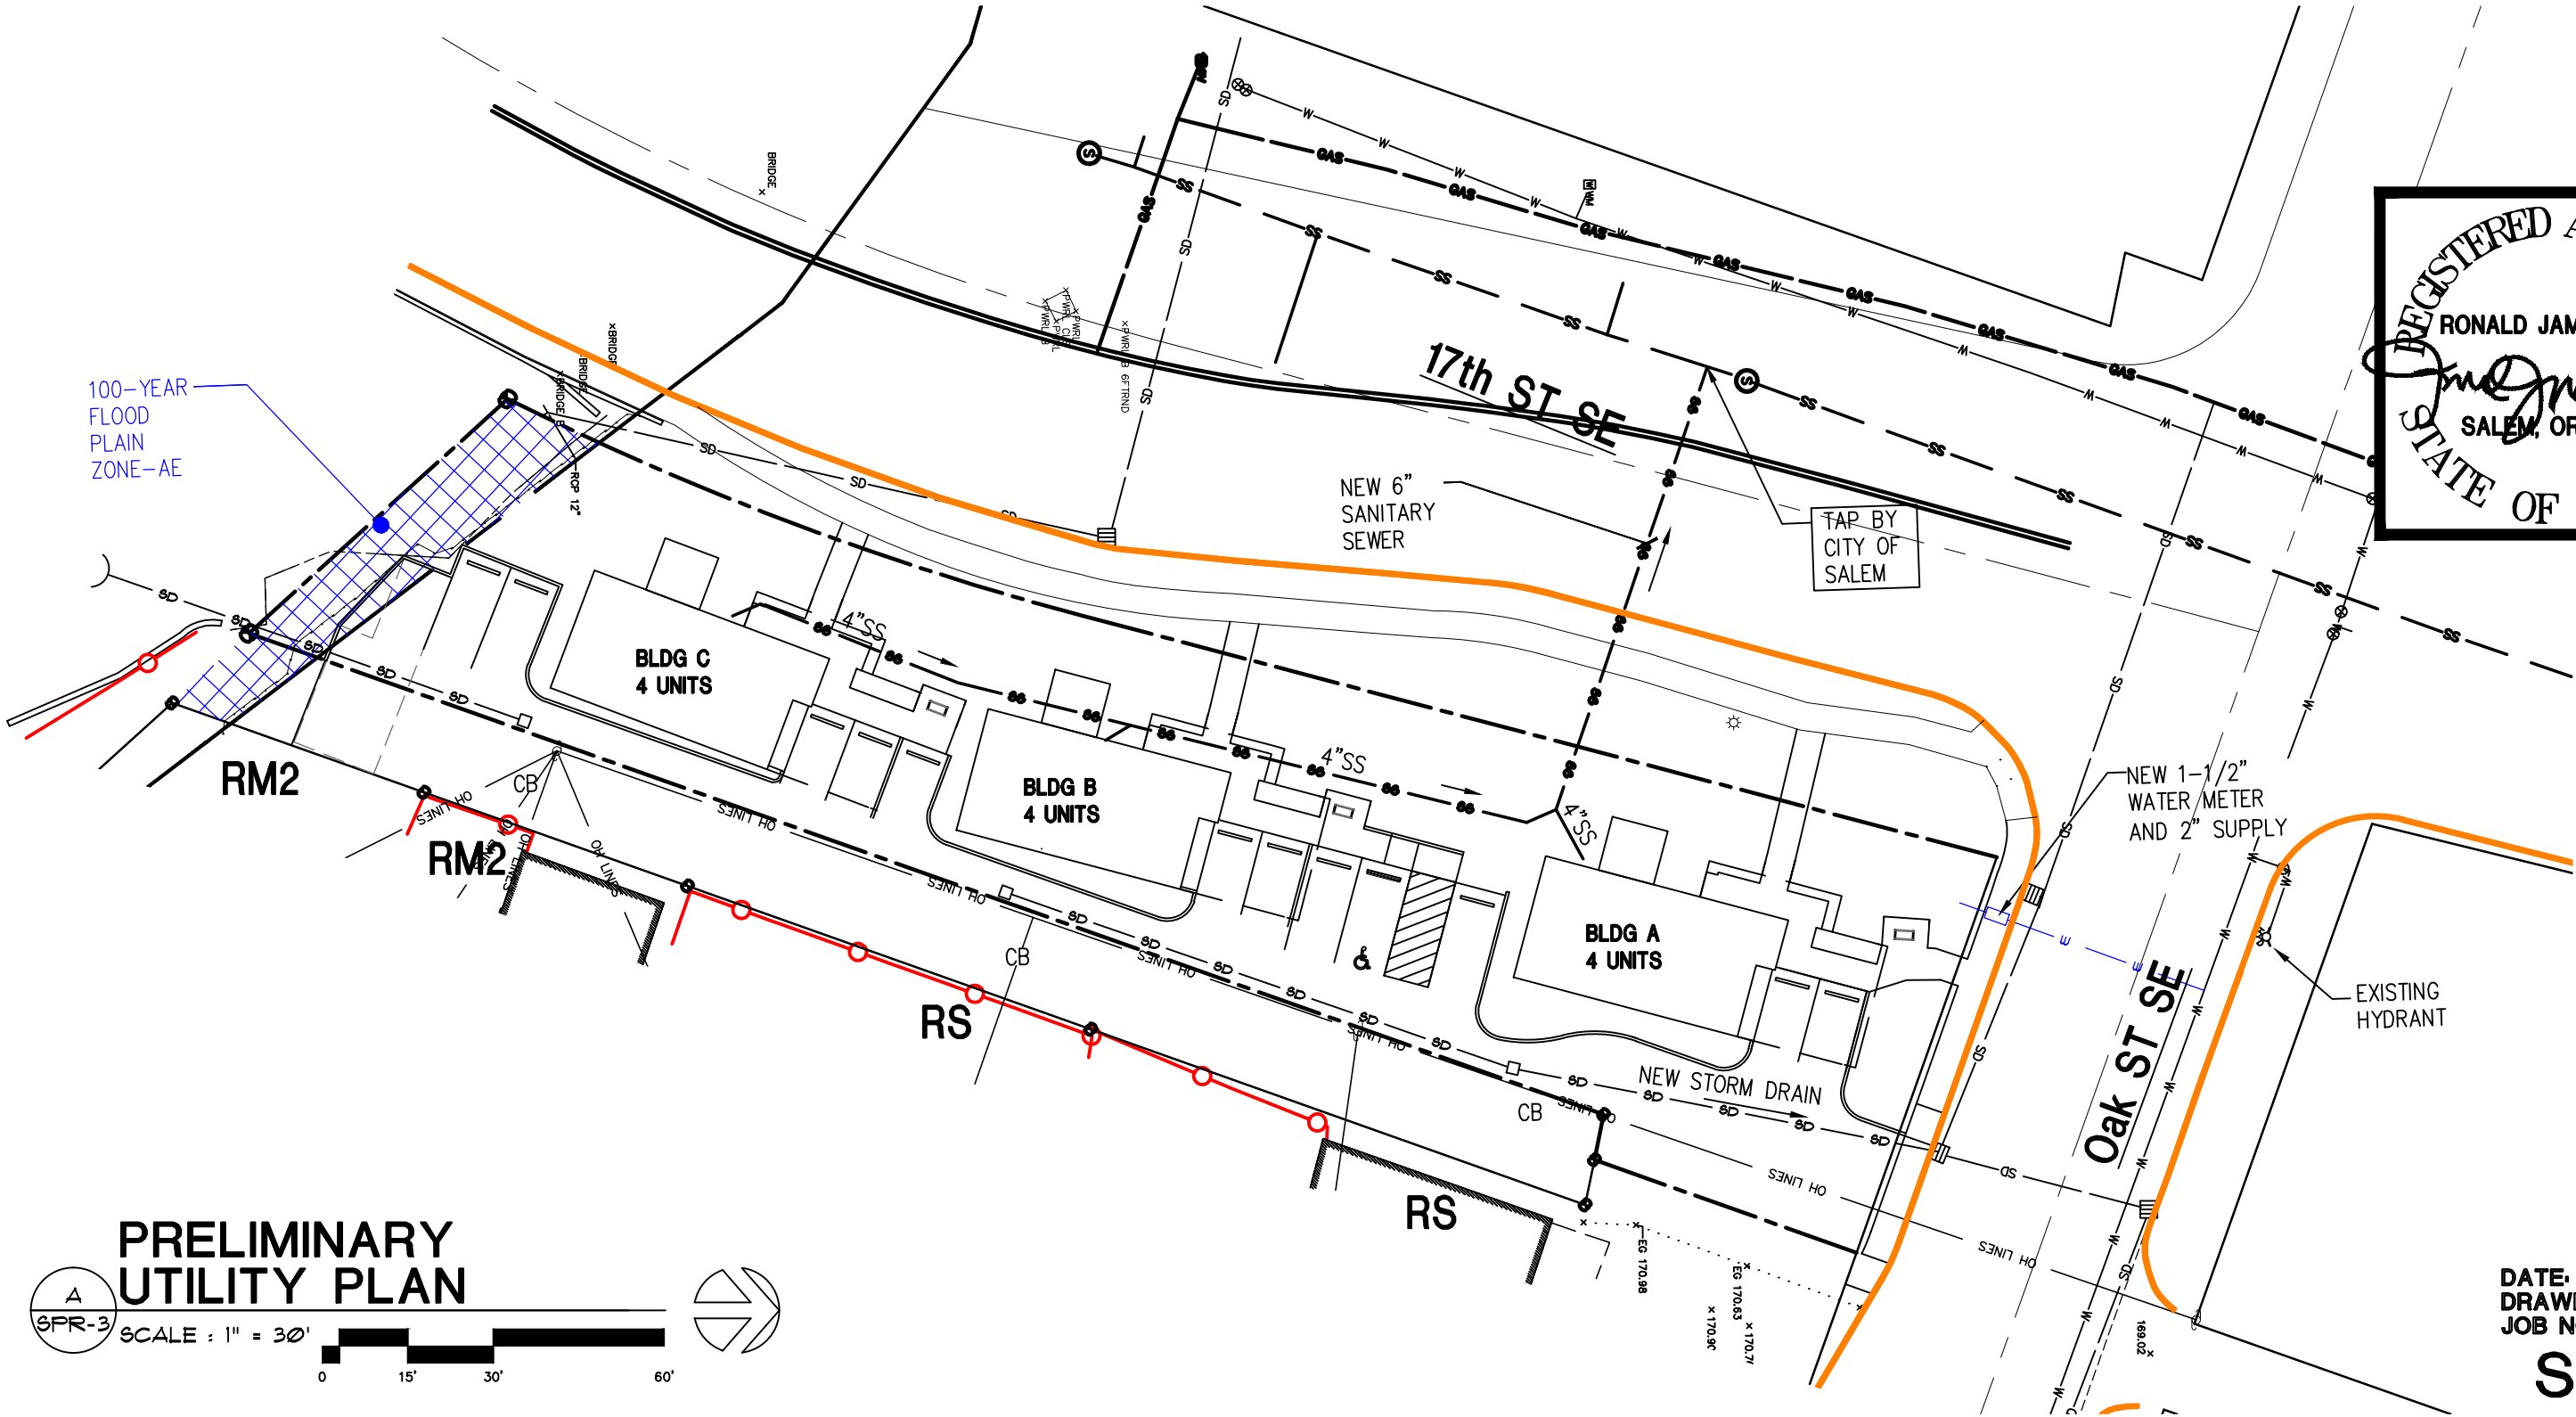

NEW APARTMENTS FOR:
SERVANDO GARCIA
17th and OAK, SALEM OR 97301

DATE: 02-07-2024
DRAWN: TB
JOB NO.: 2159

SPR-3

PRELIMINARY
UTILITY PLAN

SPR-3

SCALE : 1" = 30'

0

15'

30'

60'