



555 Liberty Street SE / Room 305 • Salem OR 97301-3503 • Phone 503-588-6213 • Fax 503-588-6025
www.cityofsalem.net/planning • www.cityofsalem.net

March 5, 2024

2nd Round – May 16, 2024

3rd Round – June 20, 2024

LAND USE APPLICATION - COMPLETENESS REVIEW

Project Information

Subject Property:	676 17 th Street SE
Reference Number:	24-103565-PLN
Application Type:	Class 3 Site Plan Review and Class 1 Design Review
Date Application Accepted:	February 7, 2024
Applicant:	Servando Garcia S & V Garcia Investments LLC PO Box 21444 8135 River Road NE Keizer, OR 97307-1444 estimating@sunsetstuccolc.com
Contact:	Ronald Ped 6850 Burnett Street SE Salem, OR 97317 rjp@rktect.com

Staff Contact

Land Use Planner:	Aaron Panko, Planner III apanko@cityofsalem.net / 503-540-2356
Infrastructure Planner:	Laurel Christian, Utility Planner II lchristian@cityofsalem.net / 503-584-4632

Land Use Review Comments

Prior to deeming your applications complete, modifications and/or additional information must be provided to address items detailed below.

Applicant should provide a response in the last column for each item or indicate if the item is not being provided. Items not addressed or provided may result in conditions of approval or denial of the land use application.

Your application, which is incomplete, will be deemed complete upon receipt of one of the following:

- (1) All of the missing information.
- (2) Some of the missing information and written notice from you (the applicant) that no other information will be provided.
- (3) Written notice from you (the applicant) that none of the missing information will be provided.

You have 180 days (August 5, 2024) from the date the application was first submitted (February 7, 2024) to respond in one of the three ways listed above, or the application will be deemed void.

The Salem Revised Code may be accessed online at the following location:

<https://www.cityofsalem.net/Pages/salem-revised-code.aspx>

<u>Completeness Review Items</u>		
<u>Submittal Requirements</u> – The following items have been identified as required material to be provided by the application(s) prior to deeming the application “complete”:		
Submittal Requirement	Description	Applicant Response <i>ie. Written Response, Submitted, Not Providing</i>
Pre-Application Conference Submitted	Design Review applications require mandatory pre-application conferences. Per SRC 300.300(c)(4)(A), mandatory pre-application conferences shall be held within 18 months of the date of application submittal. Please request another pre-application conference or submit a request for a pre-application waiver.	
Site Plan <u>220.005(e)</u> Not addressed. Existing conditions plan is required to show the location of all existing trees, indicating their species, DBH, critical root zone, and whether they will be preserved or removed. See included plan markup. Critical root zones no identified correctly, appears several trees will have an impact, possibly exceeding the 30% maximum allowance.	Per SRC 220.005(e)(1)(C), a tree plan, of a size and form and in the number of copies meeting the standards established by the Planning Administrator, containing the following information: <ol style="list-style-type: none"> (i) The total site area, dimensions, and orientation relative to north; (ii) The location of all existing trees, indicating their species, DBH, critical root zone, and whether they will be preserved or removed; (iii) The location of all new trees proposed to be planted on the development site, indicating their species and caliper at the time of planting; (iv) The perimeter and soil depth of all proposed tree planting areas; (v) The location of all existing and proposed primary and accessory structures; (vi) The location of all existing and proposed parking and vehicle use areas; and (vii) For developments that include more than one-half acre of new off-street surface parking, the tree plan shall include the expected tree canopy area after 15 years for all trees. A tree plan meeting the requirements of this section was not provided in the application materials.	<i>CRZ's identified & labeled, Well under 30% is impacted,</i> <i>an arborist will provide a letter at time of building permit app.</i>

Page 3 of 9

	<p>Note: The applicant's utility plan shows 1,436 sq. ft. of area set aside for GSI; however, it is unclear from the information submitted whether or not GSI can feasibly be constructed in these areas. The applicant should be aware that prior to issuance of a building permit, a stormwater report will be required that demonstrates compliance with <u>SRC 71</u>, and <u>Public Works Design Standards (PWDS) Appendix 4E</u>. Modifications to the site plan will be required if GSI cannot be accommodated in the areas set aside.</p>	<p>A civil engineer will be engaged to assist in this design prior to building permit app.</p>
<p>Replat Submittal Items</p> <p>Not addressed</p>	<p>The applicant's written statement indicates a replat will be consolidated with this land use application; however, the applicant has not provided any materials for the replat. The applicant shall submit all information listed in <u>SRC 205.025(c)</u>.</p> <p>Note: The tentative replat does not contain the information required in SRC 205.025(c). Additionally, the applicant has not submitted a title report or deeds for review by the Survey department. The applicant shall submit all information listed in SRC 205.025(c). Additional submittal items may result from review of the necessary information.</p>	<p>A deed was submitted previously.</p> <p>Please identify specific criteria missing from Prelim Plat Plan.</p>

Advisory Comments


Items of Concern - The following items are not listed in the SRC as specific requirements for a complete application; however, are advisories that address areas of concern on the application. **Failure to address advisory comments could result in condition of approval or denial of the application(s).**

Item	Description	Applicant Response ie. Written Response, Submitted, Not Providing
Chapter 514 – RM-II (Multi-Family Residential) Zone		
RM-II Zone – Zone to zone setbacks Adjustment Submitted	SRC 514.010(d), Table 514-4 and Table 514-5 requires a minimum 10-foot setback to the abutting RS zoned property to the east. No vehicle use area setback is provided. Please revise the site plan to comply with the minimum standard, or request an adjustment.	
RM-II Zone – Building Setbacks abutting a street Adjustment Submitted	SRC 514.010(d), Table 514-4 requires a minimum building setback of 20 feet for the proposed 35' tall buildings. Proposed buildings are setback approximately 13 feet from 17 th Street SE and approximately 12 feet from Oak Street SE. Please revise the plans to comply with minimum standard.	
Chapter 702 – Design Review		
702.015(b)(1) – Landscaping Standards	Where a development site abuts property that is zoned RS (Single Family Residential), a combination of landscaping and screening shall be provided to buffer between the multi-family residential development and abutting RS zoned property.	

Not addressed. See included plan markup.

Screening includes: a minimum of one tree for every 30 linear feet of abutting property width and a minimum six foot tall, decorative, sight obscuring fence or wall.

No screening is proposed along the eastern property line where the subject property abuts RS zoned property. Please revise the site plan to demonstrate compliance with the standard.

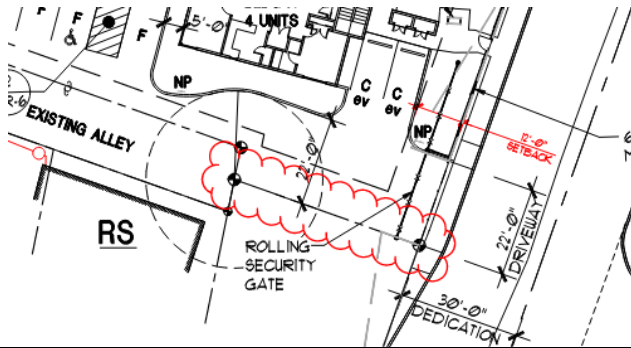


Adjustment was previously requested. A revised adjustment letter has been submitted with this response,

702.015(d)(1) – Parking and Site Design Standards
Not addressed.
Proposed configuration does not comply, an Adjustment to this standard will not be supported.

See included plan markup.


To minimize the visual impact of on-site parking and to enhance the pedestrian experience, off-street surface parking areas and vehicle maneuvering areas shall be located behind or beside buildings and structures. Off-street surface parking areas and vehicle maneuvering areas shall not be located between a building or structure and a street.

Off-street parking spaces are proposed between the ground level of the northern most building and Oak Street SE. Please adjust the orientation of the building and parking so parking spaces are not proposed between the ground floor and abutting street.

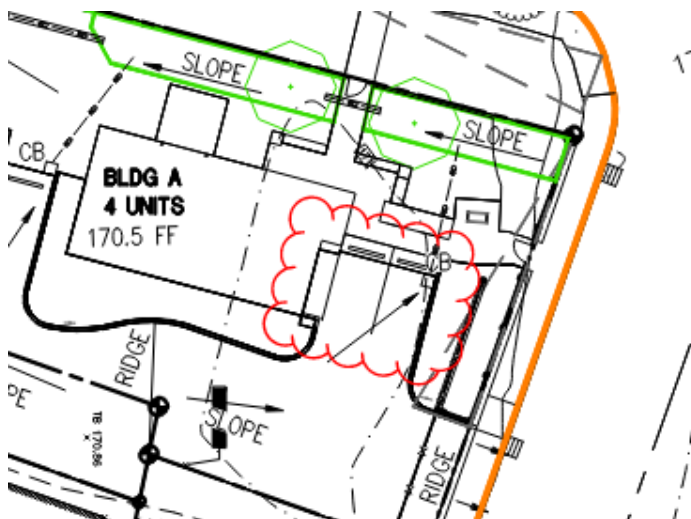


Parking spaces are provided on the under the upper floors of the building, however there is no

Screening Wall added.

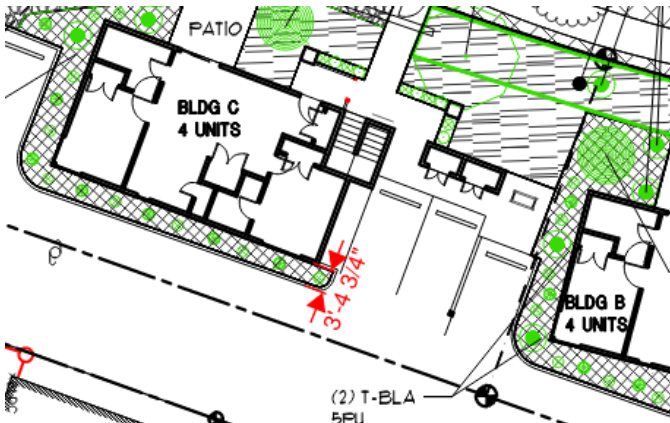	screening wall provided to obstruct view of the parking area.	
702.015(d)(2) – Parking and Site Design Standards Okay	<p>To ensure safe pedestrian access to and throughout a development site, pedestrian pathways shall be provided that connect to and between buildings, common open space, and parking areas, and that connect the development to the public sidewalks. Pedestrian pathways shall be a minimum of five feet in width.</p> <p>A pedestrian pathway connection to the southern most parking spaces and solid waste service area is required.</p>	
Chapter 800 – General Development Standards		
800.055 Solid waste service areas Okay	<p>SRC 800.055(e)(1) – The proposed front opening does not comply with the minimum 12 foot standard.</p> <p>SRC 800.055(f)(1)(A) – Vehicle operation area does not appear to comply with minimum dimensions.</p> <p>SRC 800.055(f)(1)(E) and SRC 800.055(f)(2) – Turnaround not provided for solid waste service vehicles. Need to demonstrate that vehicles will not be required to back onto a public street to leave the premises.</p>	
Chapter 806 – Off-Street Parking		
Vehicle Use Areas – Perimeter Setbacks & Vehicle Turnaround Okay	<p>SRC 806.035(f) Off-street parking area access and maneuvering.</p> <p>No vehicle turnaround area is provided within the proposed off-street parking area. Please submit a revised site plan demonstrating compliance with minimum turnaround requirements.</p>	
Vehicle Use Area Setback Adjacent to Buildings and Structures Not addressed. Vehicle use area proposed within five feet of exterior wall. See included plan markup.	<p>SRC 806.035(c)(5) Where an off-street parking or vehicular use area is located adjacent to a building or structure, the off-street parking or vehicular use area shall be setback from the exterior wall of the building or structure by a minimum five-foot-wide landscape strip, planted to the Type A standard set forth in SRC chapter 807, or by a minimum five-foot-wide paved pedestrian walkway.</p> 	An adjustment has been requested. See revised letter.

Electric Vehicle Service Capacity Okay	<p>SRC 806.015(d)</p> <p>any newly constructed building with five or more dwelling units on the same lot, including buildings with a mix of residential and nonresidential uses, a minimum of 40 percent of the off-street parking spaces provided on the site for the building shall be designated as spaces to serve electrical vehicle charging. In order to comply with this subsection, such spaces shall include provisions for electrical service capacity, as defined in ORS 455.417.</p> <p>Please show which units will be wired for electrical service capacity and show compliance on the utility plan.</p>	
Bicycle Parking Okay	<p>SRC 806.055 requires one space per unit. A minimum of 12 bicycle parking spaces are required for the proposed development. Please demonstrate compliance with this section.</p> <p>If bicycle parking is proposed within units, please show locations on the floor plans that comply with required dimensions. If proposed outside, please show on site plan.</p>	
Chapter 807 – Landscaping and Screening & Chapter 808 – Preservation of Trees and Vegetation		
<p>SRC 808.020 Trees and Native Vegetation in Riparian Corridors Not addressed. Additional details required on existing conditions plan and site plan demonstrating compliance with tree protection requirements.</p> <p>See included plan markup. Critical root zones no identified correctly, appears several trees will have an impact, possibly exceeding the 30% maximum allowance.</p>	<p>No person shall remove a tree in a riparian corridor or native vegetation in a riparian corridor. Evidence from a certified arborist or landscape architect shall be provided demonstrating no trees or native vegetation will be removed from the riparian area.</p> <p>Per SRC 808.046, any trees or native vegetation required to be preserved shall be protected during construction with the installation of an above ground silt fence, or its equivalent. The above ground silt fence shall encompass 100 percent of the critical root zone of the tree.</p> <p><i>Critical root zone</i> means the circular area beneath a tree established to protect the tree's trunk, roots, branches, and soil to ensure the health and stability of the tree. The critical root zone measures one-foot in radius for every one-inch of dbh of the tree or, as an alternative for non-significant trees, may be specifically determined by an arborist.</p>	<p><i>Tree Protection Plan updated,</i></p> <p><i>All impacts are below 30%</i></p>

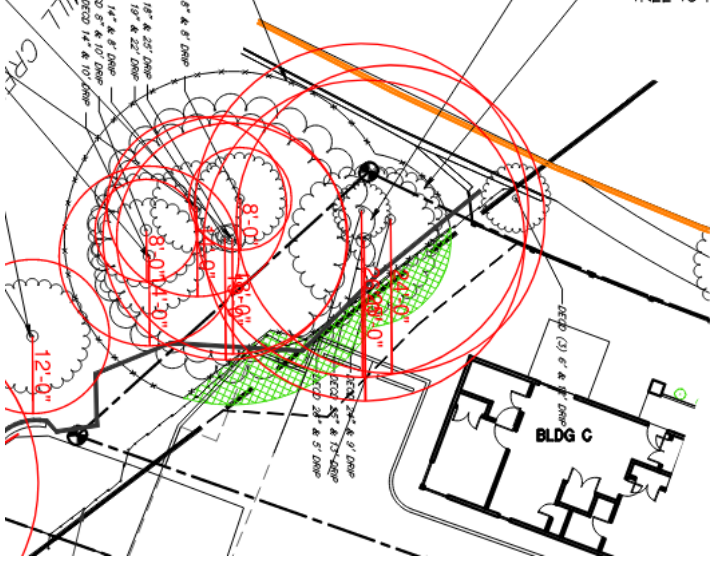		
Additional Items of Concern		
<p>Wetlands and/or Hydric Soils</p> <p>WLUN to be sent by the City. Nothing required from applicant at this time.</p>	<p>There are Salem-Keizer Local Wetland Inventory linear channel wetlands and/or hydric soils mapped on the subject property. The applicant shall contact the Oregon Department of State Lands to verify if any permits are required for future development. The applicant is required to verify mapped wetland area(s). Once the application is deemed complete, Public Works will send Wetlands Notice to the Department of State Lands, as required by SRC 809.025.</p>	
<p>Primary Alley Access</p> <p>Pavement shown.</p>	<p>As a condition of utilizing the alley for primary access for employee parking, the applicant is required to widen the alley approach in order to provide adequate circulation, the applicant should revised the plans to show improvements to the alley.</p>	
<p>Open Channel/Drainage Easements</p> <p>Shown on replat. Will be listed as a condition of approval. See note.</p>	<p>Pursuant to Public Works Design Standards (PWDS) 1.8(d), the application is subject to open channel drainage easements to be dedicated along the creek, allowing for access and maintenance. The easement width shall be either the 100-year floodway boundary, 15-feet from the channel centerline, or 10-feet from the top of the recognized bank, whichever is greatest.</p> <p>The applicant shows structures and parking within the easement area and this is not permitted. The plans should be updated to remove obstructions from easements and the floodway.</p>	

	<p>Note: The applicant indicates parking is allowed in this easement. However; SRC 205.080(g)(2)(B) requires consent from the easement holder for placement of fill or other obstructions in the easement area. The applicant would be required to demonstrate that the proposal does not impact drainage within the channel through the required no-rise certification.</p>	
<p>Lot Legality and Configuration</p> <p>Outstanding. Replat items needed.</p> <p>No title report, chain of title, or deeds provided for review.</p>	<p>The survey section has previously reviewed the information submitted for this site. The subject property appears to be made up of multiple units of land under separate ownership. The buildings and improvements appear to cross internal property lines. The applicant should indicate if a replat application will be consolidated with this application or filed for separately and conditioned.</p> <p>Comments from Survey section attached.</p>	<p>Deed was Submitted previously. Replat is part of this app, please specify what is missing still</p>