
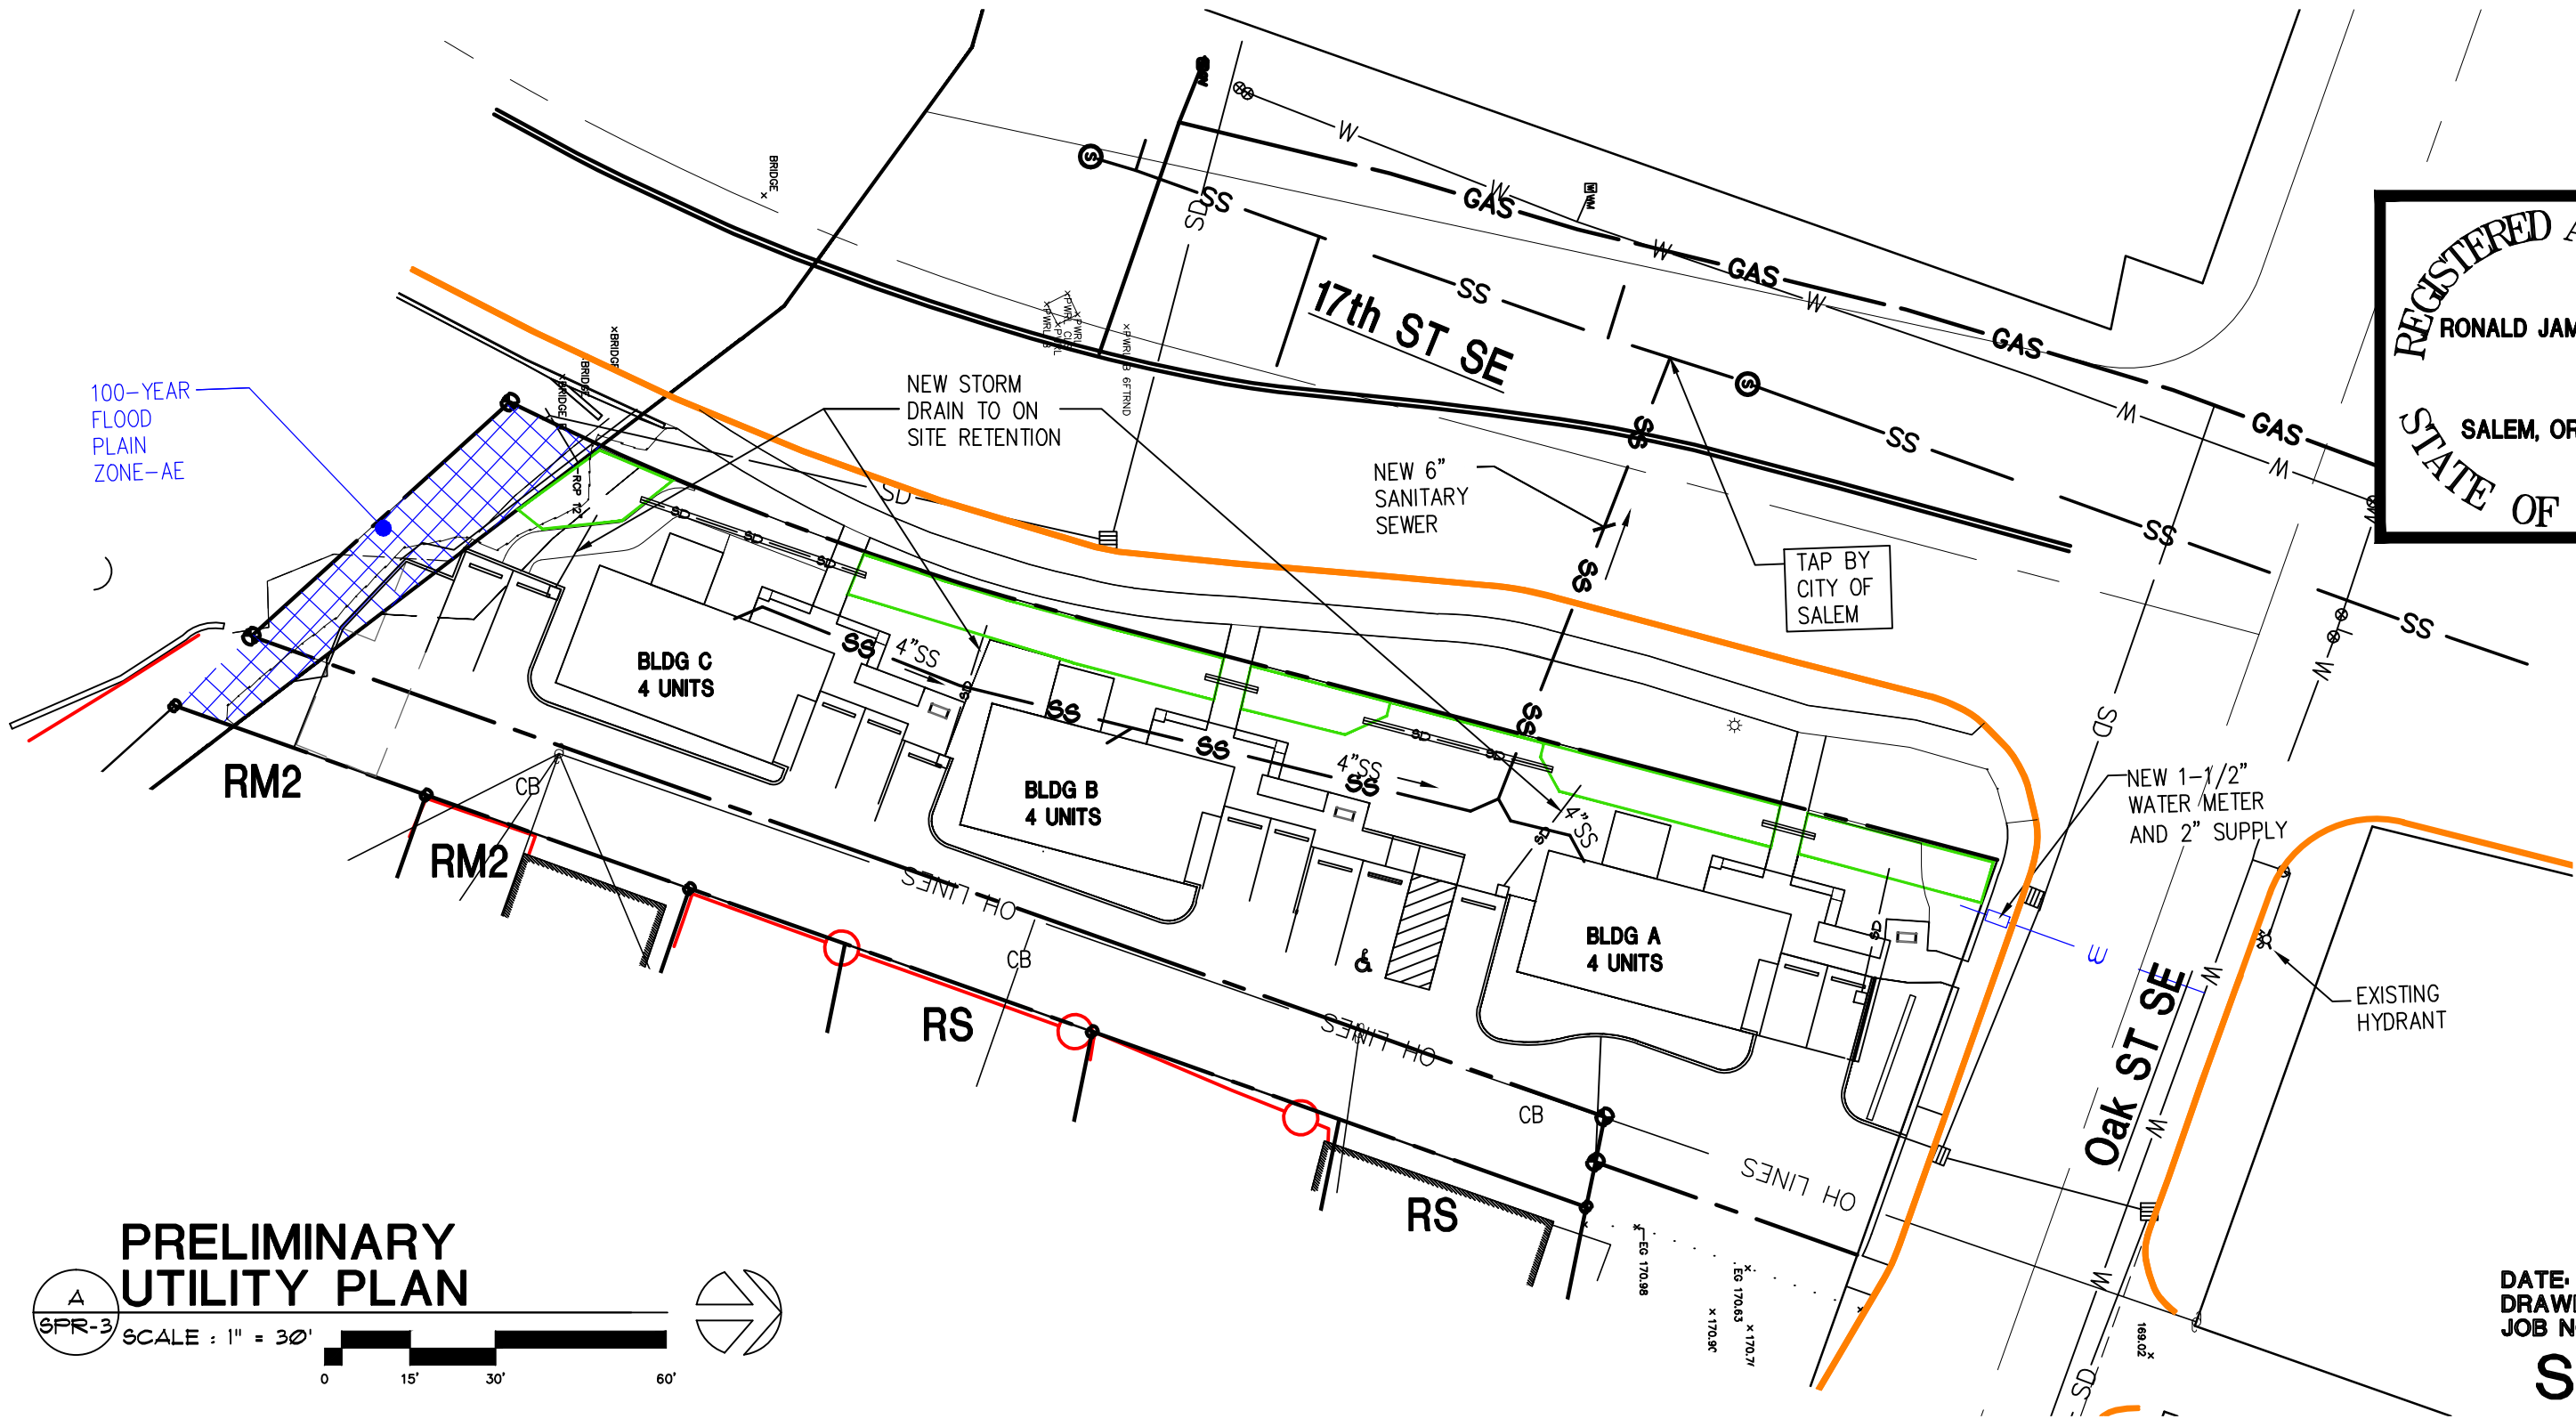


TABLE 610.4 235.5 WSFU @ OVER 60 PSI @ 215LF DEVELOPED LENGTH 1-1/2" METER WITH 2" BUILDING SUPPLY MAIN
--

TABLE 703.2 222 DFU = USE 6" MAIN FOR 120 DFU
--

FIRE FLOW 1320 SF x 32' HT = 42,240 SF/100 = 422.4 GPM x (3) BLDG = 1267 GPM
--

REV 1 - 04.09.24
REV 2 - 05.24.24
REV 3 - 07.09.24

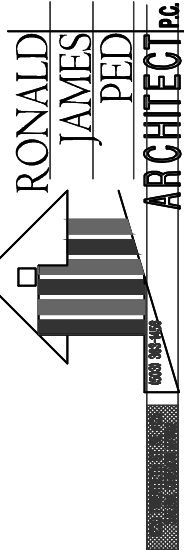

PRELIMINARY UTILITY PLAN

SCALE : 1" = 30'

NEW APARTMENTS FOR:
SERVANDO GARCIA
17th and OAK, SALEM OR 97301

DATE: 02-07-2024
DRAWN: TB
JOB NO.: 2159

SPR-3