


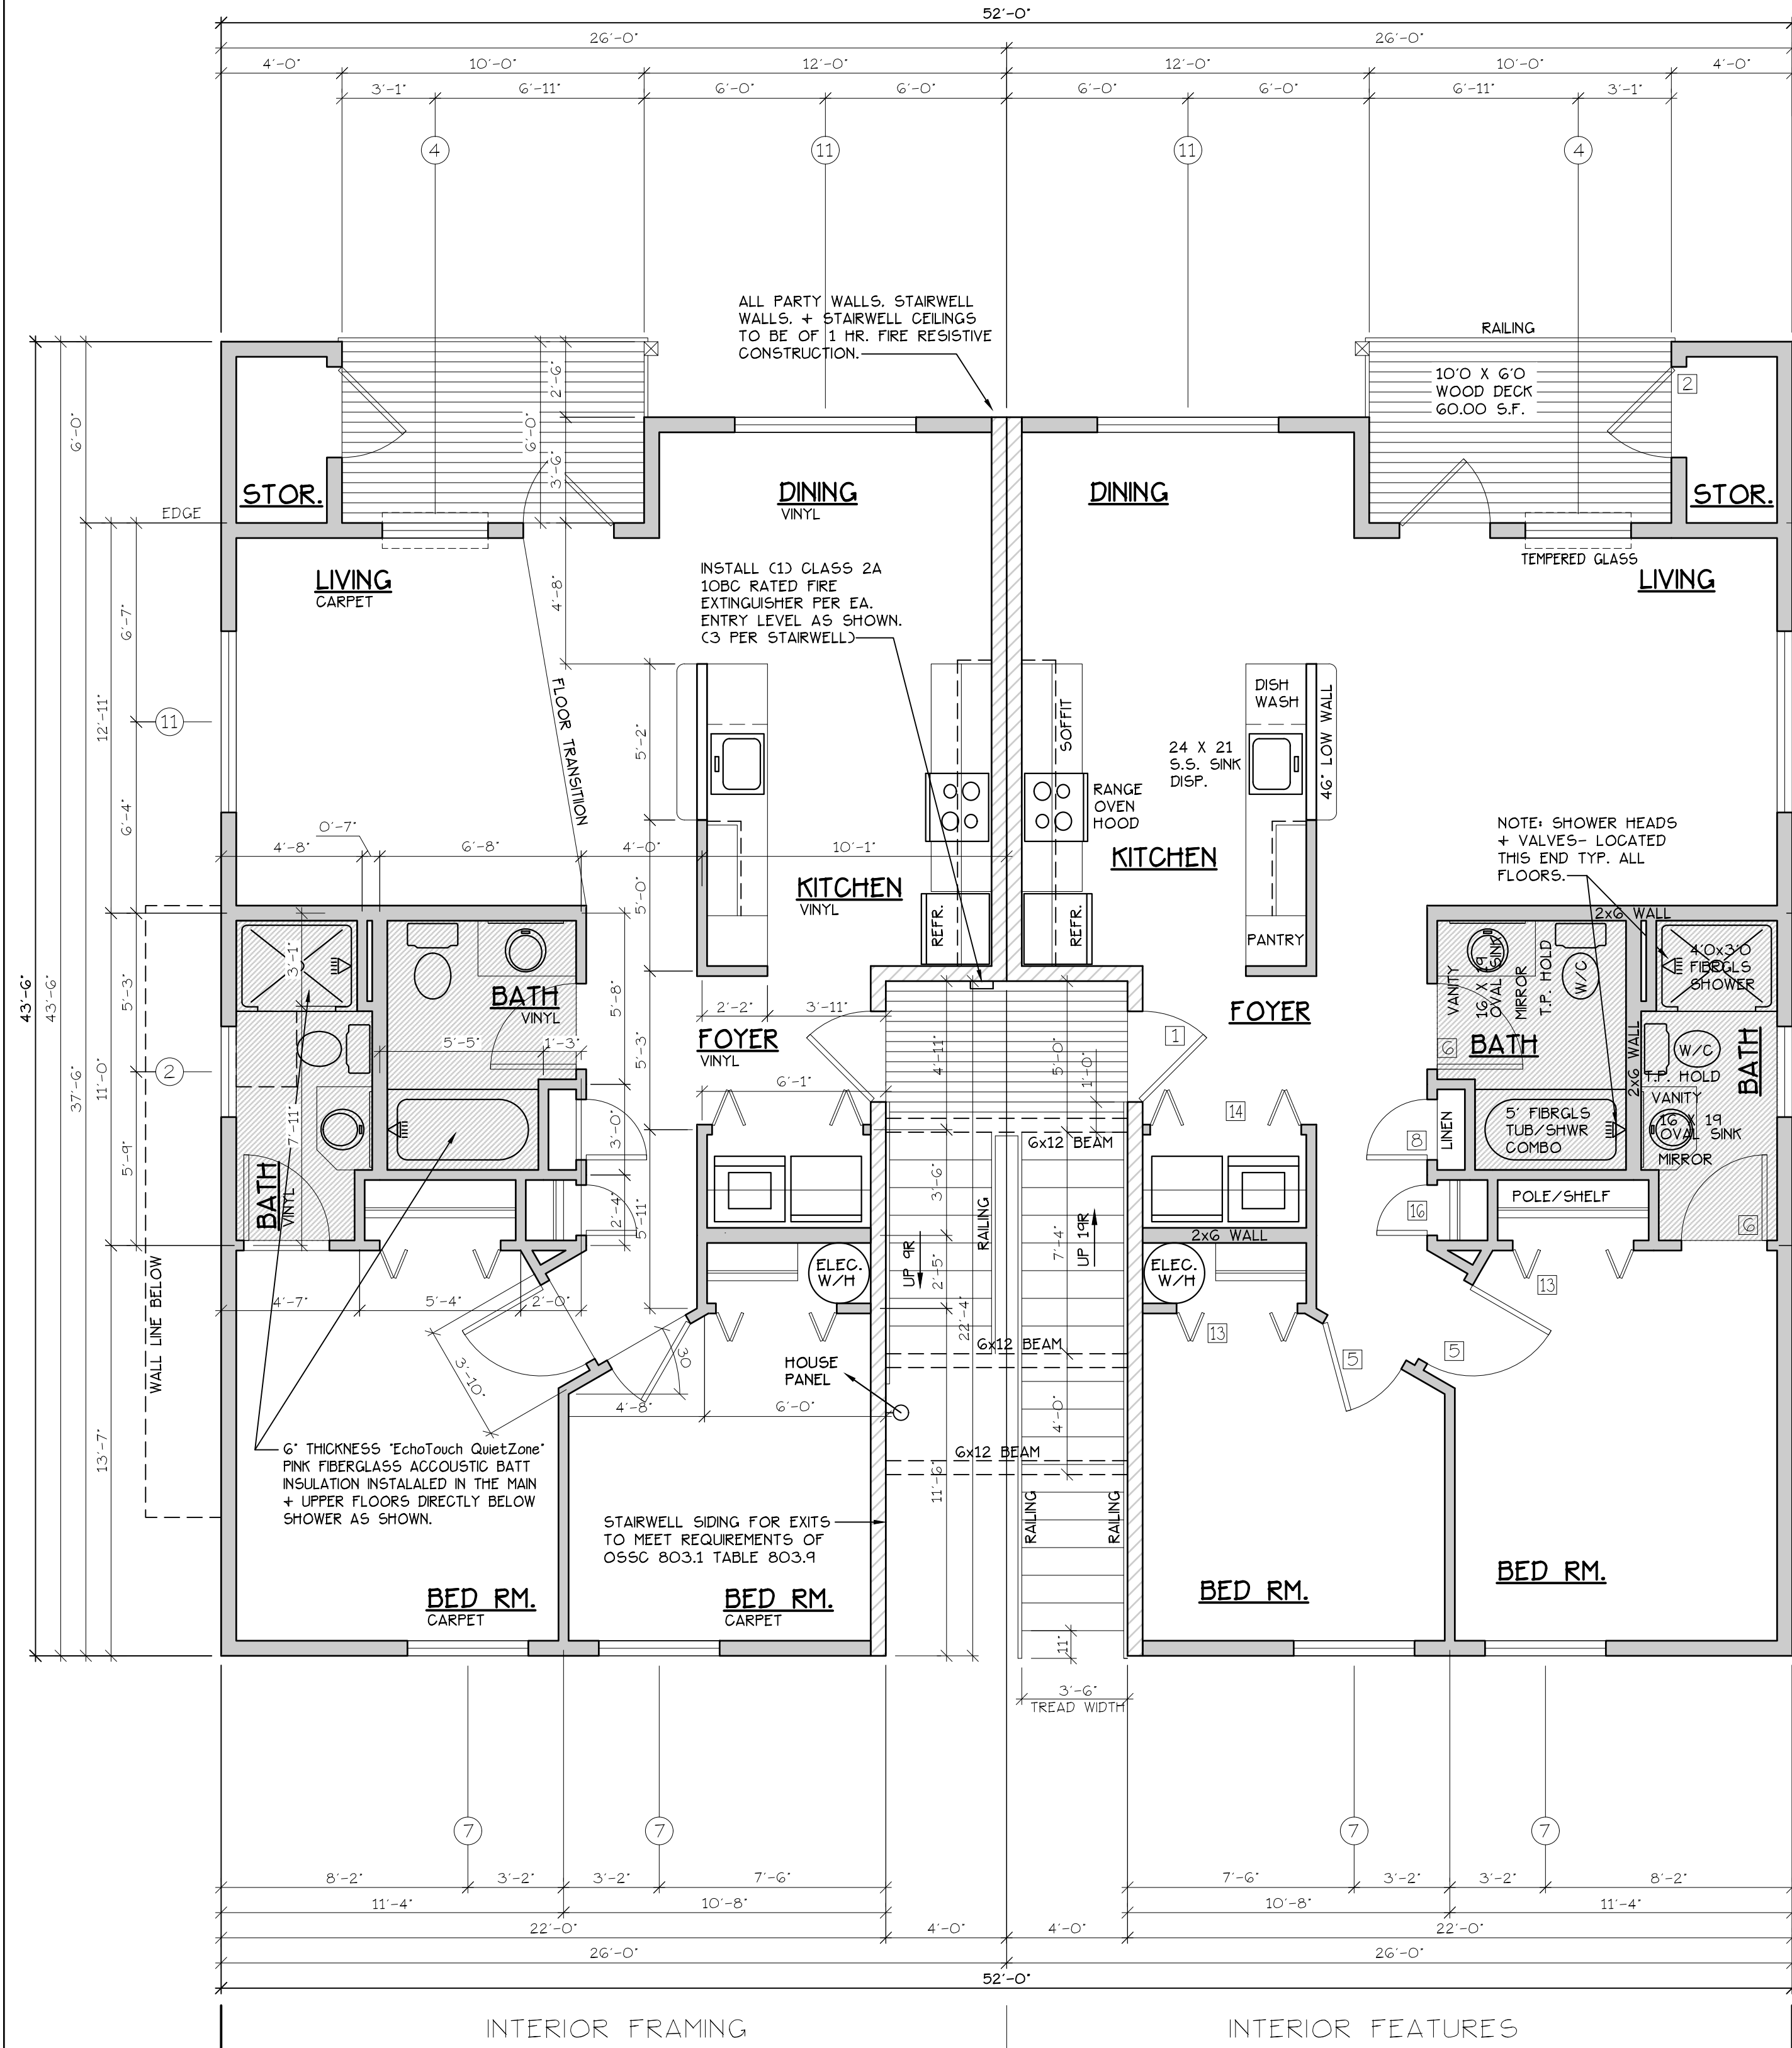

MAIN FLOOR PLAN

SCALE: 1/4" = 1'-0"

A UNIT = 952 S.F.

TYPE A UNITS

BLD. 4


CONSTRUCTION TYPE V B SPRINKLED
SEE WALL DETAIL SHEETS FOR
SHEETROCK APPLICATION.

DOOR SCHEDULE									
DOORS			FRAMES			REMARKS			
#	WIDTH	HEIGHT	THICK	TYP.	MATE.	FIN.	TYP.	MATE.	FIN.
[1]	3'-0"	6'-8"	1 3/4"	MTL.	GLAD	PAINT	A	METAL	PAINT
[2]	3'-0"	6'-8"	1 3/4"	MTL.	GLAD	PAINT	B	METAL	PAINT
[3]	3'-0"	6'-8"	1 3/4"	MTL.	GLAD	PAINT	C	METAL	PAINT
[4]	2'-6"	6'-8"	1 3/4"	MTL.	GLAD	PAINT	D	METAL	PAINT
[5]	3'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	E	HEMLOCK	STAIN
[6]	2'-10"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	F	HEMLOCK	STAIN
[7]	2'-10"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	F	HEMLOCK	STAIN
[8]	2'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	E	HEMLOCK	STAIN
[9]	2'-10"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	F	HEMLOCK	STAIN
[10]	4'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	G	HEMLOCK	STAIN
[11]	5'-8"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	G	HEMLOCK	STAIN
[12]	6'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	G	HEMLOCK	STAIN
[13]	4'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	H	HEMLOCK	STAIN
[14]	5'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	H	HEMLOCK	STAIN
[15]	6'-0"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	H	HEMLOCK	STAIN
[16]	1'-8"	6'-8"	1 3/8"	H.G.	BIRCH	STAIN	E	HEMLOCK	STAIN

* ACCESSIBLE POCKET DOORS MUST STOP FULLY OPEN WITH THEIR OPERATING HANDLES FULLY EXPOSED.
** TO PROVIDE MINIMUM 32" NET CLEAR WIDTH PER ICC/A117.1 SEC. 1004.5.2.1 WHEN FULLY OPENED.

WINDOW SCHEDULE									
#	SIZE	TYPE	MFG.	COLOR	INSUL.	REMARKS	HEADERS		
[1]	3'-0" X 1'-0"	VINYL STAT.	MILGARD	WHITE	YES	STATIONARY W/ FROSTED GLASS	DF #1 4x12		
[2]	3'-0" X 1'-0"	VINYL STAT.	MILGARD	WHITE	YES	STATIONARY W/ FROSTED GLASS	DF #1 4x12		
[3]	3'-0" X 4'-6"	VINYL SQH.	MILGARD	WHITE	YES	SINGLE HUNG W/ SCREEN	DF #1 4x12		
[4]	3'-6" X 4'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[5]	4'-0" X 3'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[6]	4'-0" X 4'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[7]	4'-0" X 5'-0"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF#1 6x8 CSEF ALT. HEADER DETAIL 5HT. A15.40.3		
[8]	5'-0" X 2'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[9]	5'-0" X 4'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[10]	5'-0" X 5'-0"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF#1 6x8 CSEF ALT. HEADER DETAIL 5HT. A15.40.3		
[11]	6'-0" X 4'-6"	VINYL SLD.	MILGARD	WHITE	YES	HORIZ. SLIDER W/ SCREEN	DF #1 4x12		
[12]	4'-0" X 5'-0"	CASEMENT	MILGARD	WHITE	YES	CASEMENT W/ SCREEN	DF #1 4x12		

NOTE: ALL LOWER FLOOR OPERABLE WINDOWS + HARDWARE TO COMPLY WITH O.S.S.C. 2014 CHAPTER 11 SEC. 1107.2 ON TO ICC/ANSI A117.1 THEN SEC. 1002.9. OPERABLE PARTS SHALL COMPLY WITH SEC. 309. SEE "OPERABLE WINDOWS IN ACCESSIBLE LOCATIONS" DETAIL ON SHEET ADA-5. ALL LOWER FLOOR WINDOW HEADERS TO BE SET MIN. 7'-0" A.F.F. UNO.

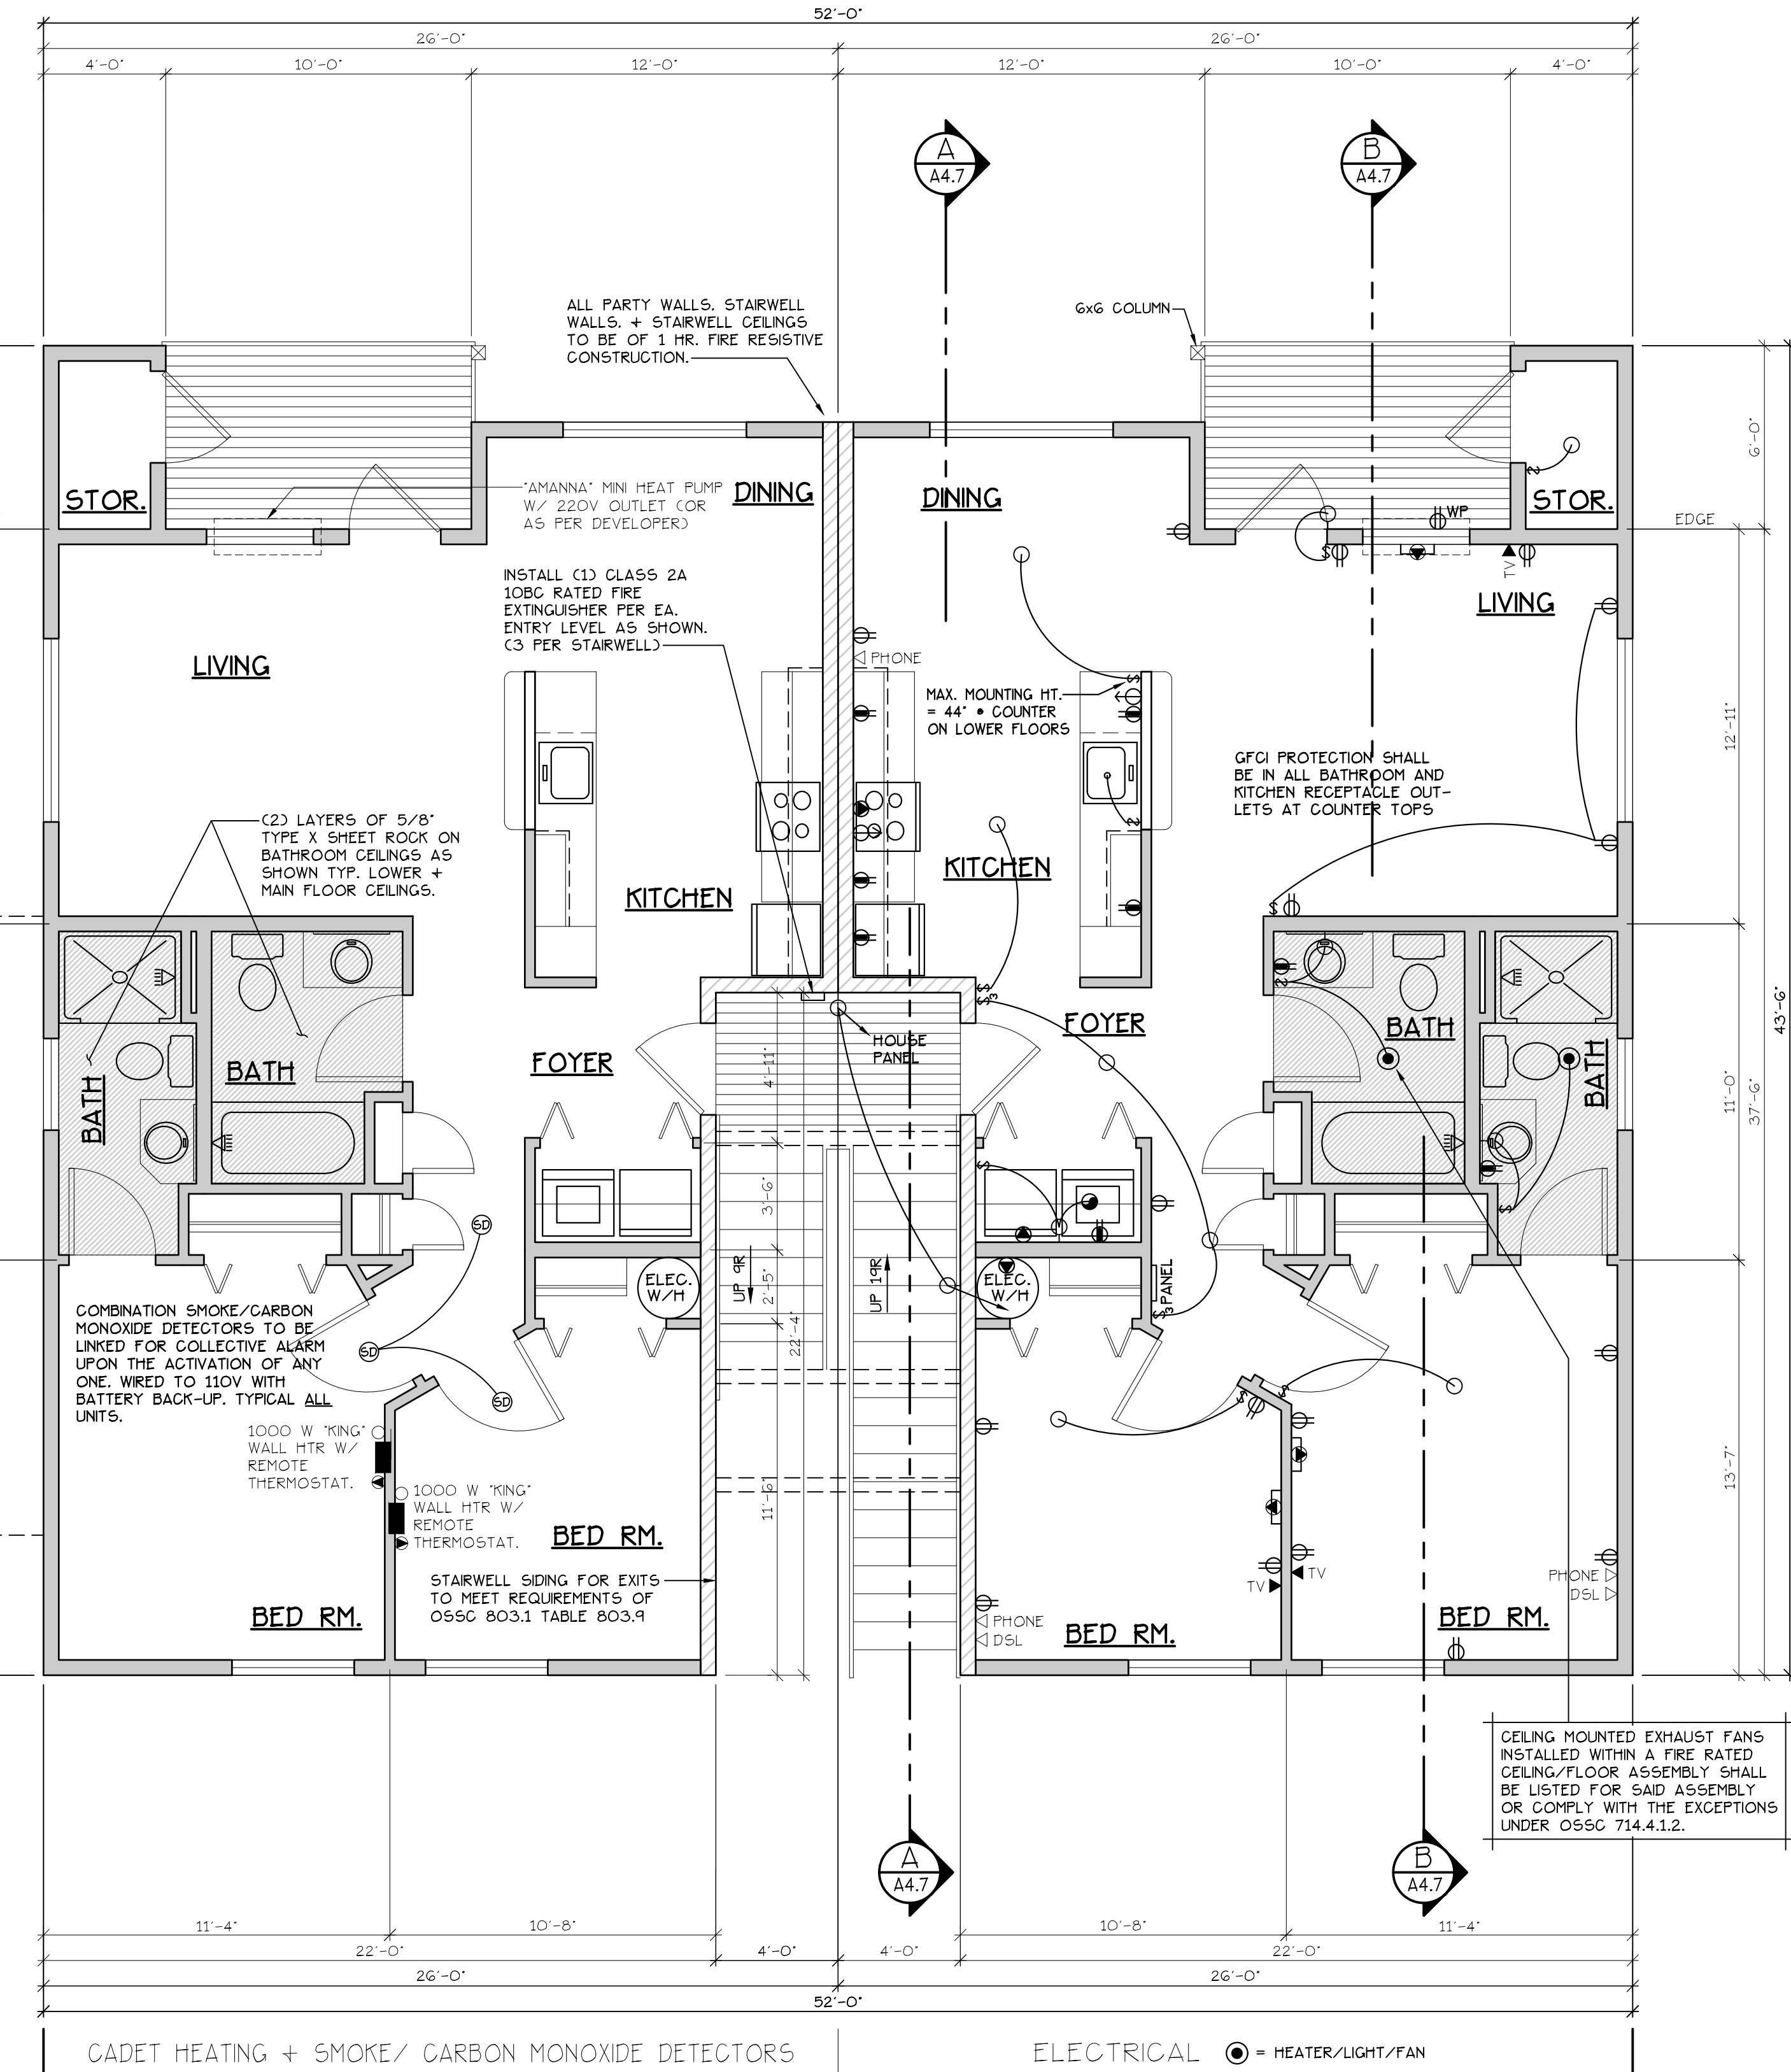

CADET HEATING + SMOKE/ CARBON MONOXIDE DETECTORS

ELECTRICAL ● = HEATER/LIGHT/FAN

NOTE: ALL ACCESSIBLE DOORS SHALL BE PROVIDED WITH LEVER DOOR HARDWARE + OTHER OPERATING DEVICES IN COMPLIANCE WITH ICC/ANSI A117.1 SECTIONS 309.4. + 404.2.6.

NOTE: MAX. U-VALUE FOR ALL WINDOWS AS PER TABLE 401.1(2) OESG U-0.32.

NOTE: WINDOW SILLS MORE THAN 72" ABOVE FINISH GRADE SHALL BE A MINIMUM OF 36" ABOVE FINISH FLOOR SURFACE (COR) BE INSTALLED WITH WINDOW OPENING CONTROL DEVICES IN COMPLIANCE WITH THE 2014 OESG SECTIONS 1013.8.1 AND 1029.4.

NOTE: FOR WINDOW PLACEMENT SEE "WINDOW PLACEMENT FOR EGRESS AND FALL PROTECTION" DETAIL ON SHEET A15.40.

NOTE: MAIN + UPPER FLOOR DOORS ARE SIZED THE SAME AS LOWER FLOOR DOORS. DOOR SIZE OPTIONS FOR MAIN + UPPER FLOORS ARE AS FOLLOWS:
BED RM. = 2'-6" DOOR
BATH RM. = 2'-4" DOOR.

SEE "GENERAL STRUCTURAL NOTES" ON SHEET A4.2 BEFORE BEGINNING ANY CONSTRUCTION.

GENERAL NOTES:

- ALL EXTERIOR WALLS TO BE 2 X 6 STUDS. ALL OTHER WALLS TO BE 2 X 4 STUDS UNLESS OTHERWISE NOTED.
- FIRE BLOCK CONCEALED SPACES (VERTICAL + HORIZONTAL) AS PER OESG 718.2.2 AND OESG 718.2.3.
- PRIOR TO INSTALLATION OF FIBERGLASS TUB/SHOWER + SHOWER UNITS, SHEET ROCK SHALL BE APPLIED TO STUD WALLS AS INDICATED ON PLANS.
- ALL BATH FANS TO HAVE MIN. 80 CFM. RANGE HOOD EXHAUST FANS TO HAVE MIN. 150 CFM.
- ELECTRIC OUTLETS IN 1 HR. WALL MAY NOT BE BACK TO BACK AND MUST BE SEPARATED BY HORIZONTAL DISTANCE OF 2'-0".
- ALL EXTERIOR FLOOD LIGHTING SHALL BE CONNECTED TO HOUSE PANELS LOCATED IN ON-SITE UTILITY ROOMS + STORAGE BLD'S.
- AS PER OESG HIGH-EFFICIENCY LIGHTING SYSTEMS - A MINIMUM OF 50 PERCENT OF THE LAMPS IN PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE COMPACT OR LINEAR FLUORESCENT, OR A LIGHTING SOURCE THAT HAS A MINIMUM EFFICACY OF 40 LUMENS PER INPUT WATT.
- ALL "TYPE A" ACCESSIBLE UNITS REQUIRE THE PATIO TO BE AT SAME LEVEL AS DWELLING UNIT.

MARKET STREET APARTMENT COMPLEX MAIN FLOOR PLAN

NO CHANGES, MODIFICATIONS OR
CORRECTIONS TO BE MADE
WITHOUT WRITTEN
AUTHORIZATION FROM THE DESIGN
ENGINEER.
DIMENSIONS & NOTES TAKE
PRECEDENCE OVER GRAPHICAL
REPRESENTATION.

Design: P.L.M.
Drawn: G.L.D.
Checked: M.D.G.
Date: Jul-19
Scale: AS SHOWN
JOB # 6847

REGISTERED PROFESSIONAL
ENGINEER
JULY 12, 1978
MARK D. SEELY
Renew date: June 30, 2021

A4.41