


APPROVED ADDRESS NUMBERS SHALL BE PAINTED OR AFFIXED TO THE FRONT OF THE BUILDING IN A CONTRASTING AND HIGHLY VISIBLE COLOR, NOT LESS THAN 4" IN HEIGHT FOR RESIDENTIAL USE. THE NUMBERS SHALL BE AFFIXED PRIOR TO FINAL INSPECTION. (S1B) (UFC 10.301) (ORD 774)

A ROADSIDE MARKER SHALL BE PLACED AT THE ACCESS POINT WITH ADDRESS NUMBERS IN A CONTRASTING AND HIGHLY VISIBLE COLOR, NOT LESS THAN 3" IN HEIGHT.

ALL EXTERIOR MATERIALS AND FINISHES ARE FOR PRESENTATION PURPOSES ONLY. ACCRUAL MATERIALS, FINISHES, AND GRADE UP TO BUILDERS DISCRETION.

NOTE:
ACTUAL FINISHED GRADES MAY VARY FROM FINISHED GRADES SHOWN ON ELEVATIONS AND PLANS.

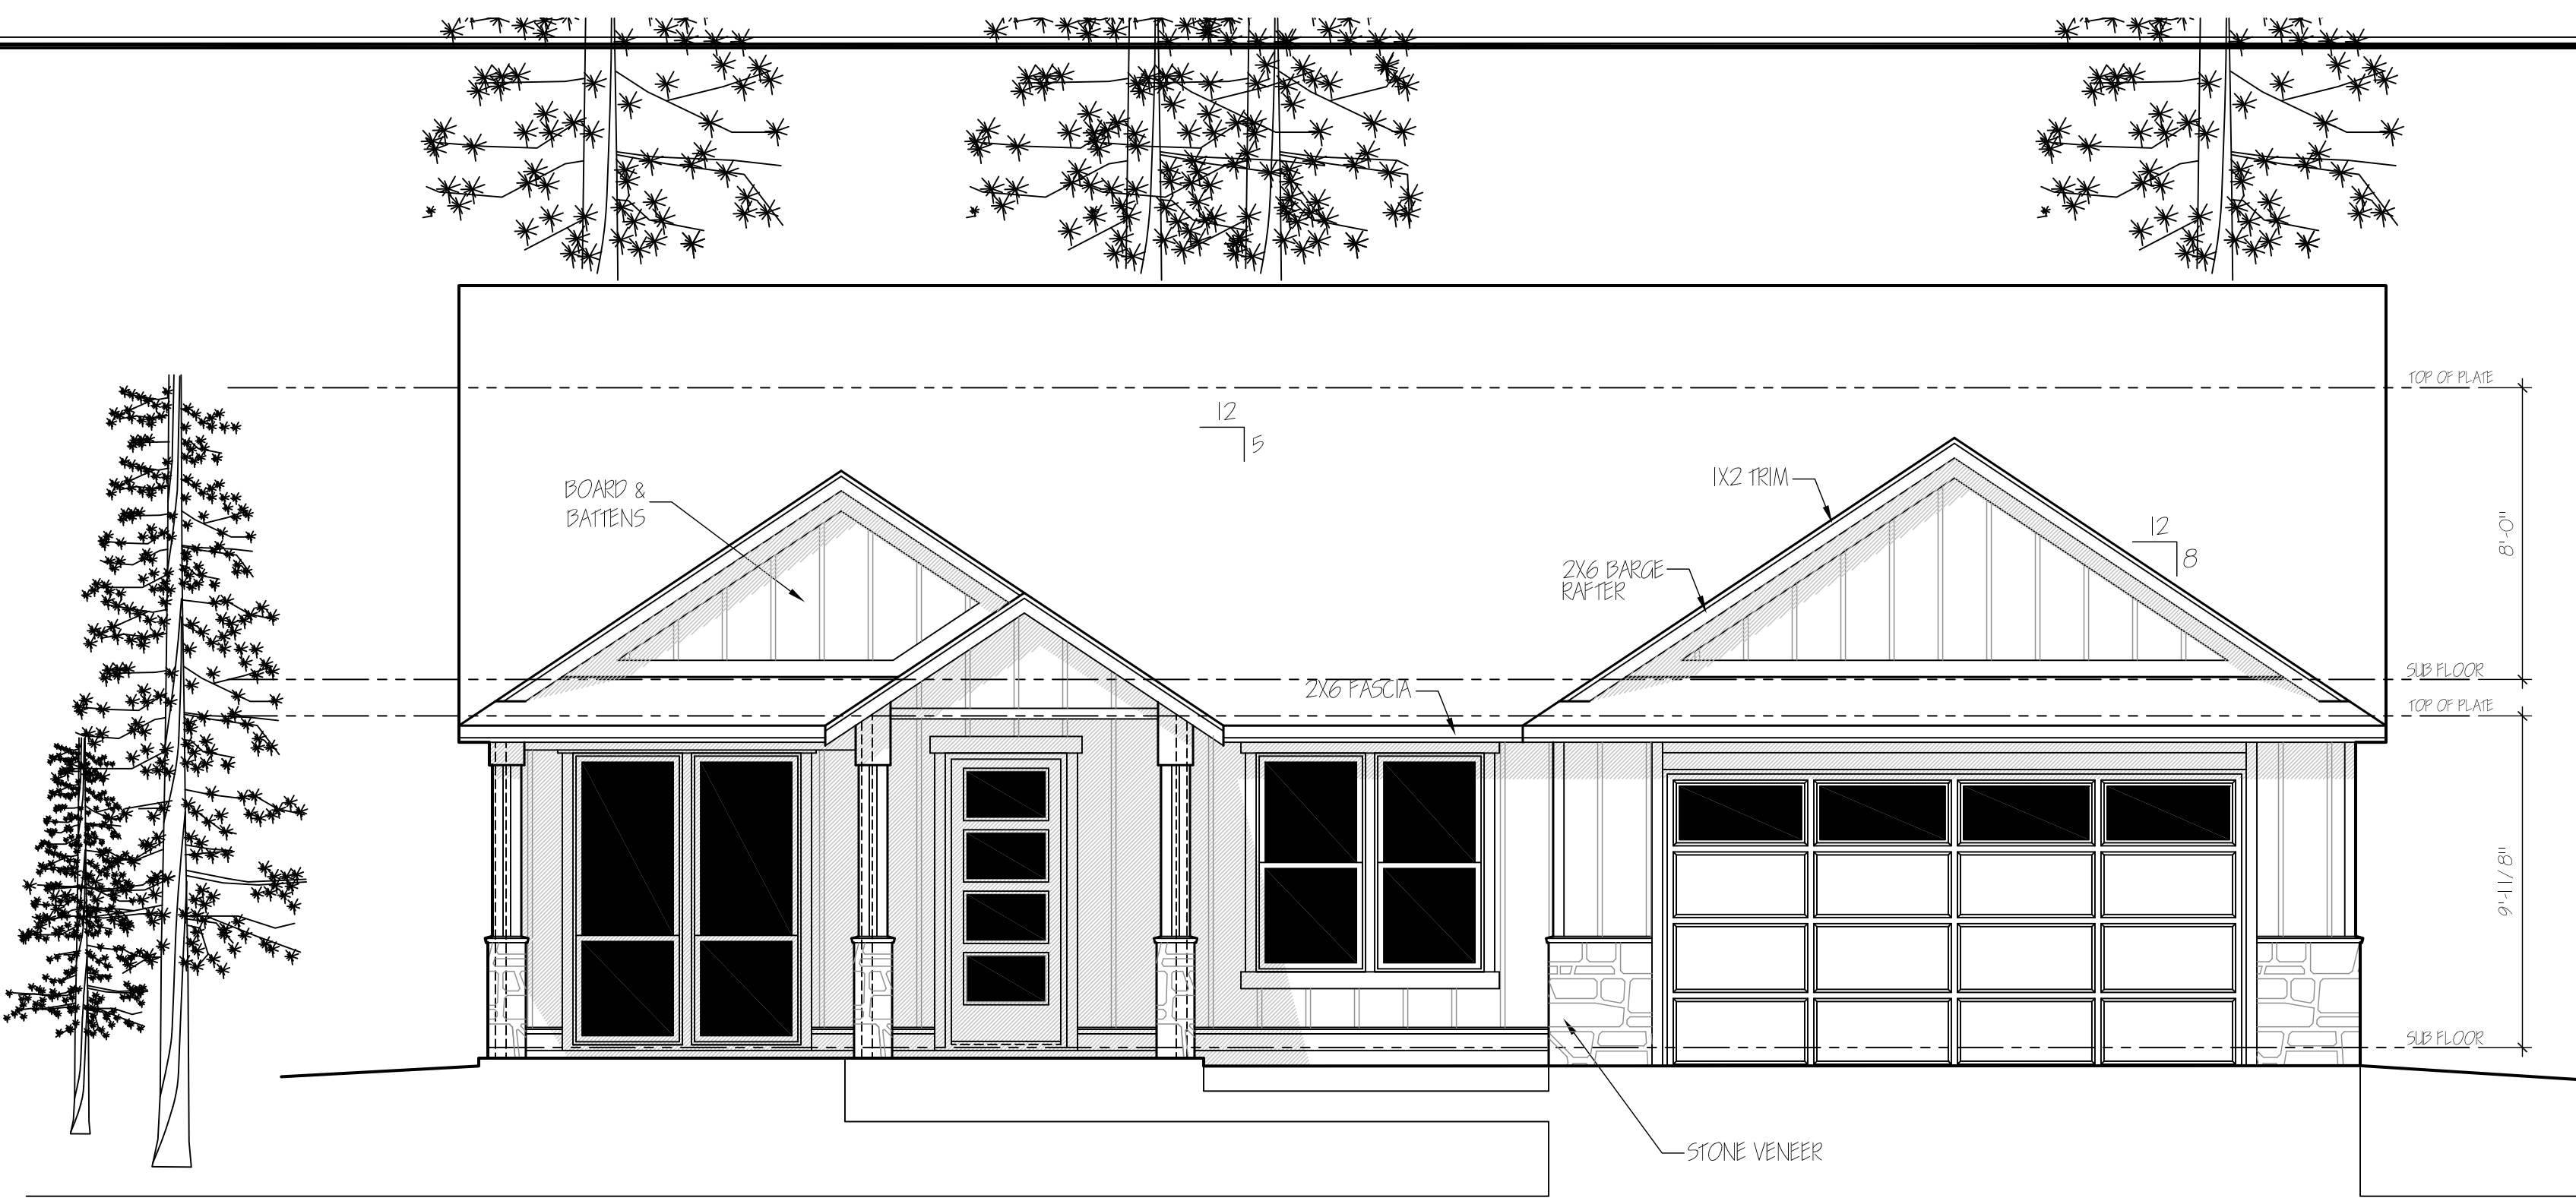

FRONT ELEVATION



LEFT ELEVATION



RIGHT ELEVATION



BACK ELEVATION


BUILDING COMPONENTS:	
MAXIMUM ALLOWABLE AREA	NO LIMIT
WINDOW GLASS	U = 0.28
DOORS, OTHER THAN ENTRY	U = 0.20
MAIN ENTRY DOOR (MAX. 24 SQ. FT.)	U = 0.20
WALL INSULATION	R-25
UNDERFLOOR INSULATION	R-38
FLAT CEILINGS	R-49
VAULTED CEILINGS	R-30
SKYLIGHT GLASS	U = 0.90
SKYLIGHT AREA	LESS THAN 2%
BASEMENT WALLS	R-21
SLAB FLOOR EDGE INSULATION	R-15
FORCED AIR DUCT INSULATION	R-8

BUILDING INFORMATION	
APPLICABLE CODES: INTERNATIONAL RESIDENTIAL CODE FOR ONE- AND TWO-FAMILY DWELLINGS	
PROJECT TYPE: NEW SINGLE FAMILY RESIDENCE	
AREA	
MAIN FLOOR	2105 SQ. FT.
UPPER FLOOR	351 SQ. FT.
GARAGE	487 SQ. FT.
TOTAL LIVING AREA	2494 SQ. FT.
ROOF DRAINAGE AREA	3211 SQ. FT.
DESIGN LOADS	
A. ROOF LIVE LOAD	= 25 P.S.F.
B. WIND LOAD	= 120 MPH, EXPOSURE B
C. SEISMIC ZONE	= CATEGORY D1
D. FROST DEPTH	= 12"
E. SOIL BEARING	= 1000 P.S.F.

GENERAL NOTES


- THE INTENT OF THESE PLANS IS TO PROVIDE THE CONTRACTOR WITH A GUIDE FOR A FULL, COMPLETE AND WORKABLE PROJECT, IN SO FAR AS THE DRAWINGS SHOW AND THE SPECIFICATIONS CALL FOR. THESE PLANS ARE INTENDED FOR USE BY PEOPLE WITH KNOWLEDGE OF BUILDING CONSTRUCTION.
- ALL WORK SHALL COMPLY WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ONE AND TWO FAMILY DWELLING CODE, AND ANY APPLICABLE LOCAL OR COUNTY JURISDICTION.
- THE CONTRACTOR IS RESPONSIBLE FOR REVIEWING THE PLANS AND IS TO NOTIFY THE DESIGNER OF ANY ERRORS OR OMISSIONS PRIOR TO THE START OF CONSTRUCTION.
- WRITTEN DIMENSIONS SHALL TAKE ALL PRECEDENCE OVER SCALED DIMENSIONS.
- HEATING/ COOLING SPECIFICATIONS AND DRAWINGS SHALL BE PROVIDED BY THE MECHANICAL CONTRACTOR AS REQUIRED BY BUILDING OFFICIALS.
- PLUMBING AND ELECTRICAL SPECIFICATIONS SHALL BE PROVIDED BY THE RESPECTIVE TRADES, AS REQUIRED BY BUILDING OFFICIALS.
- HEATING LOSS AND ENERGY CALCULATIONS SHALL BE PROVIDED BY THE MECHANICAL CONTRACTOR, OR OTHER QUALIFIED PROFESSIONAL AS REQUIRED BY BUILD OFFICIALS.
- TRUSS MANUFACTURE SHALL PROVIDE ALL DRAWINGS, SPECIFICATIONS AND ENGINEERING AS REQUIRED BY BUILDING OFFICIALS.

TABLE N1101.1(2) – ADDITIONAL MEASURES	
<input checked="" type="checkbox"/>	HIGH-EFFICIENCY HVAC SYSTEM^a a. Gas-fired furnace or boiler AFUE 94 percent, or b. Air-source heat pump HSPF 10.0/14.0 SEER cooling, or c. Ground-source heat pump COP 3.5 or Energy Star rated
<input type="checkbox"/>	HIGH-EFFICIENCY WATER HEATING SYSTEM a. Natural gas/propane water heater with minimum UEF 0.90, or b. Electric heat pump water heater with minimum 2.0 COP, or c. Natural gas/propane tankless/instantaneous heater with minimum 0.80 UEF and Drain Water Heat Recovery Unit installed on minimum of one shower/tub-shower
<input type="checkbox"/>	WALL INSULATION UPGRADE Exterior walls—U-0.045/R-21 conventional framing with R-5.0 continuous insulation
<input type="checkbox"/>	ADVANCED ENVELOPE Windows—U-0.21 (Area weighted average), and Flat ceiling ^b —U-0.017/R-60, and Framed floors—U-0.026/R-38 or slab edge insulation to F-0.48 or less (R-10 for 48"; R-15 for 36" or R-5 fully insulated slab)
<input type="checkbox"/>	DUCTLESS HEAT PUMP For dwelling units with all-electric heat, provide: Ductless heat pump of minimum HSPF 10 in primary zone replaces zonal electric heat sources, and programmable thermostat for all heaters in bedrooms
<input type="checkbox"/>	HIGH EFFICIENCY THERMAL ENVELOPE UA^c Proposed UA is 8 percent lower than the code UA
<input type="checkbox"/>	GLAZING AREA Glazing area, measured as the total of framed openings is less than 12 percent of conditioned floor area
<input type="checkbox"/>	3 ACH AIR LEAKAGE CONTROL AND EFFICIENT VENTILATION Achieve a maximum of 3.0 ACH50 whole-house air leakage when third-party tested and provide a whole-house ventilation system including heat recovery with a minimum sensible heat recovery efficiency of not less than 66 percent.

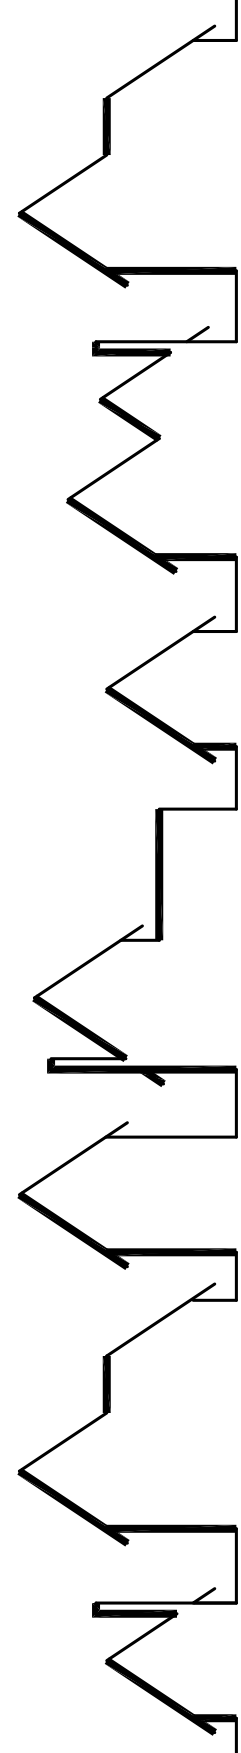


NEW HOUSE PLAN FOR
FOKSHA HOMES
LOT 2 WERN HEIGHTS, SALEM, OR 97302


FOUNDATION PLAN

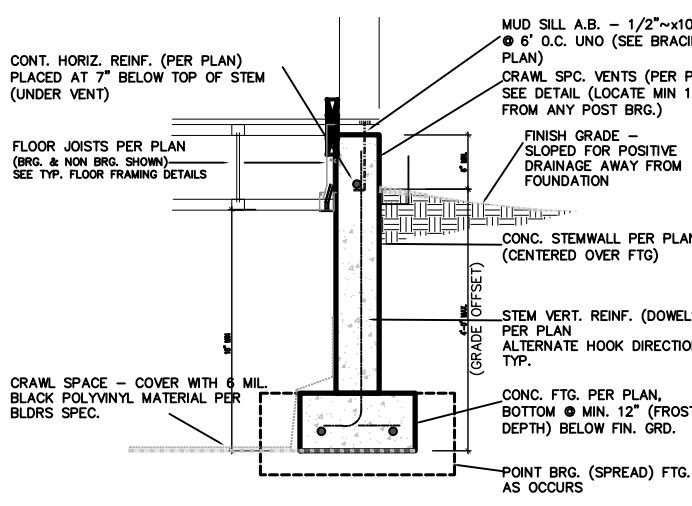


TYPICAL PERIMETER STEM / FTG.

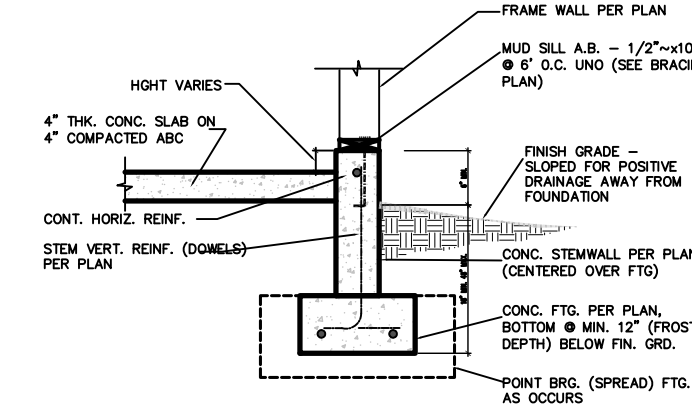


TYPICAL GARAGE STEM WALL

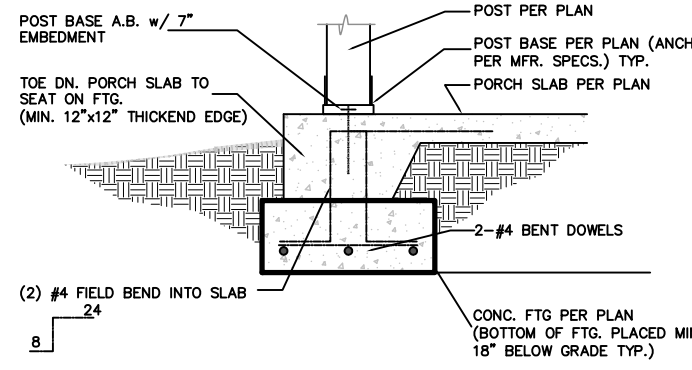


TYP. POST FTG. / BASE

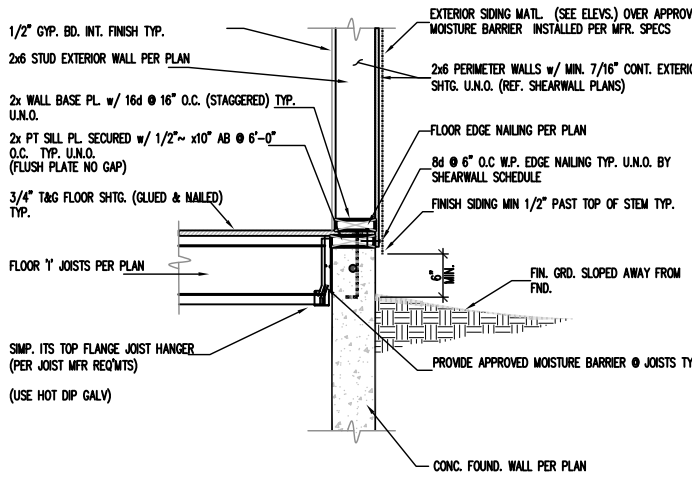


FOUNDATION FLOOR (LEDGER BRG.)

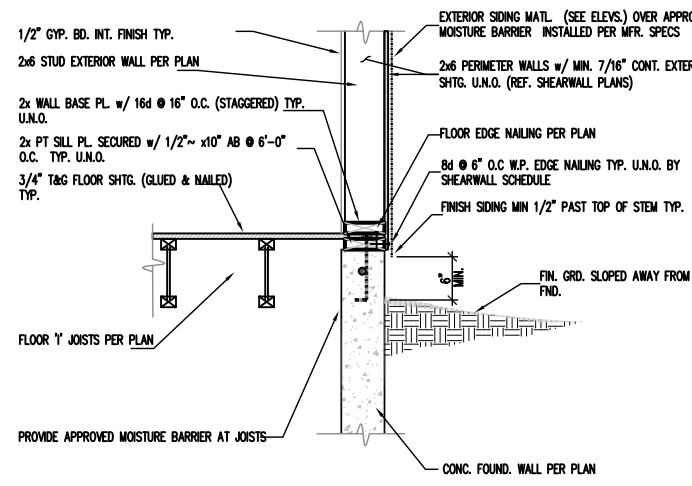

FOUNDATION FLOOR (PARALLEL STEM)

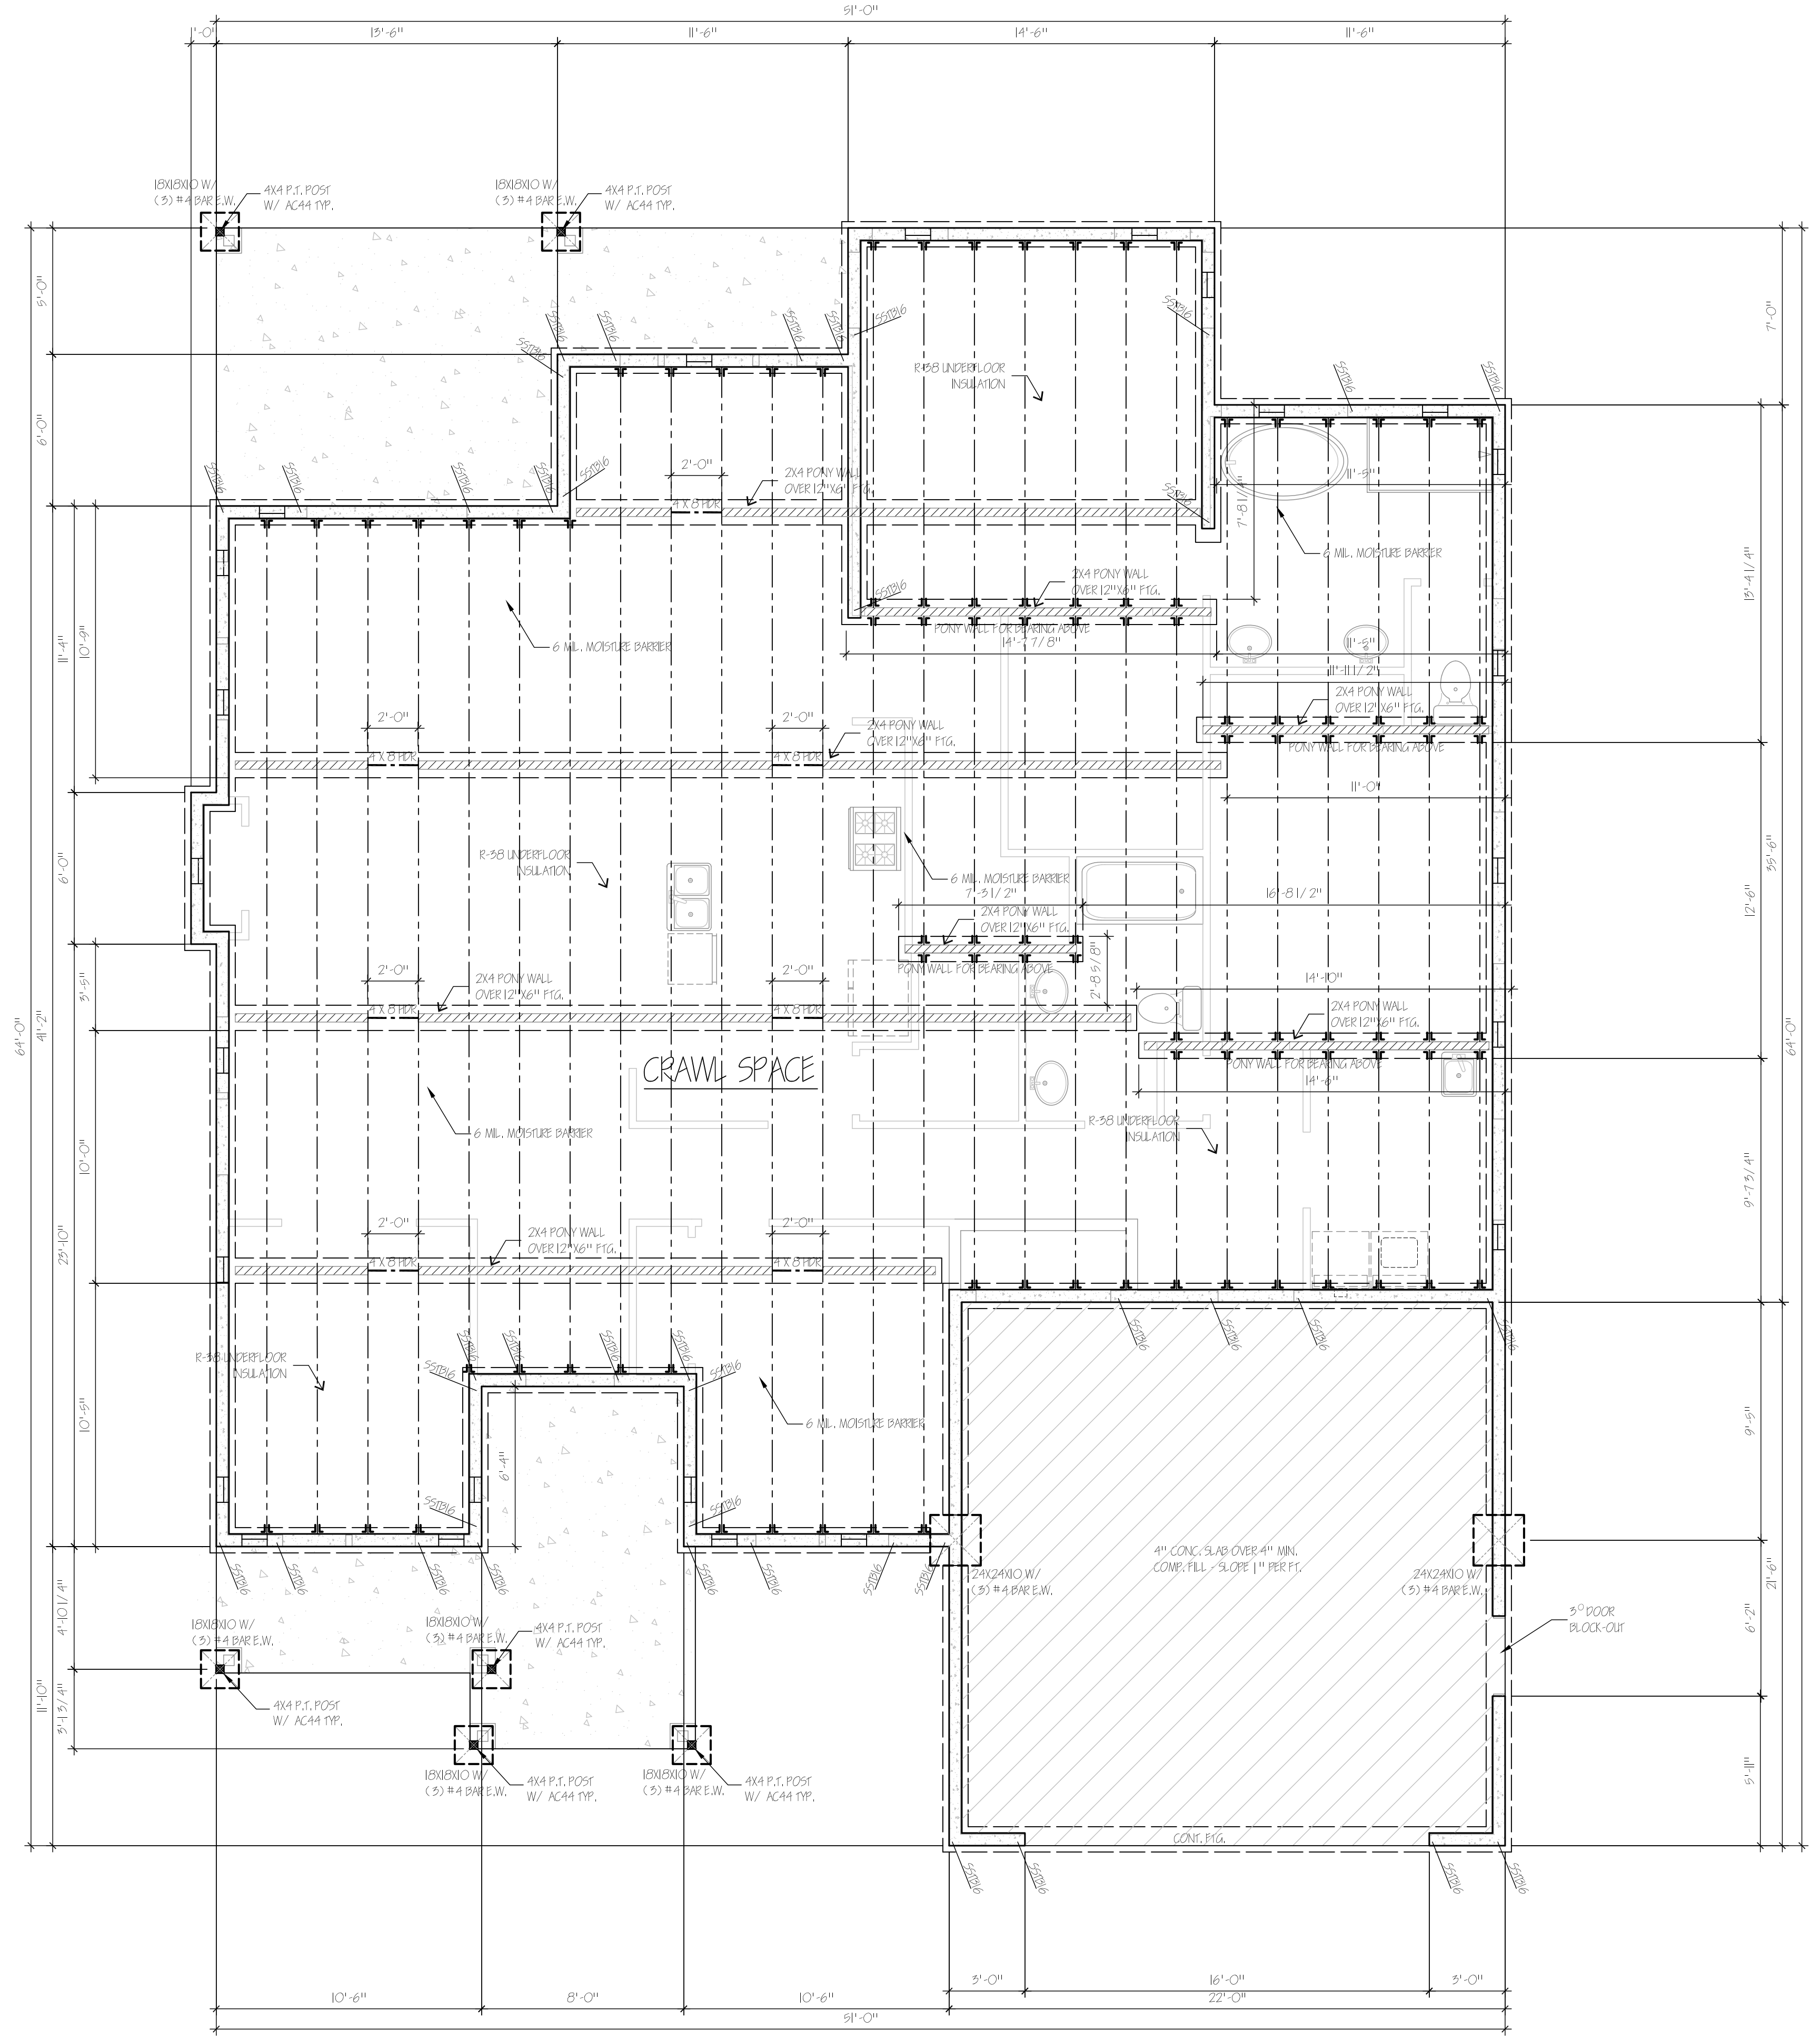

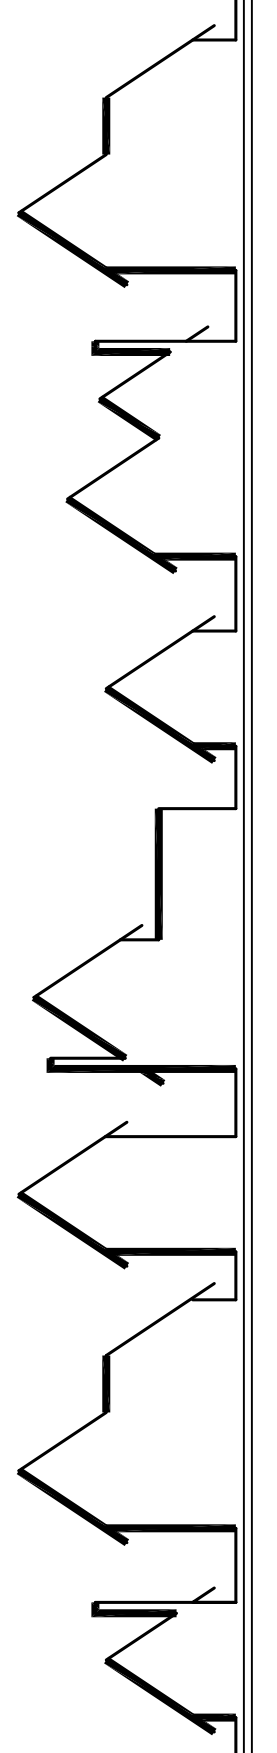



NEW HOUSE PLAN FOR
FOKSHA HOMES
LOT 2 WERN HEIGHTS, SALEM, OR 97302

MAIN FLOOR PLAN

MAIN FLOOR AREA - 2103 SQ.FT.
GARAGE FLOOR AREA - 621 SQ.FT.

MAIN FLOOR PLAN

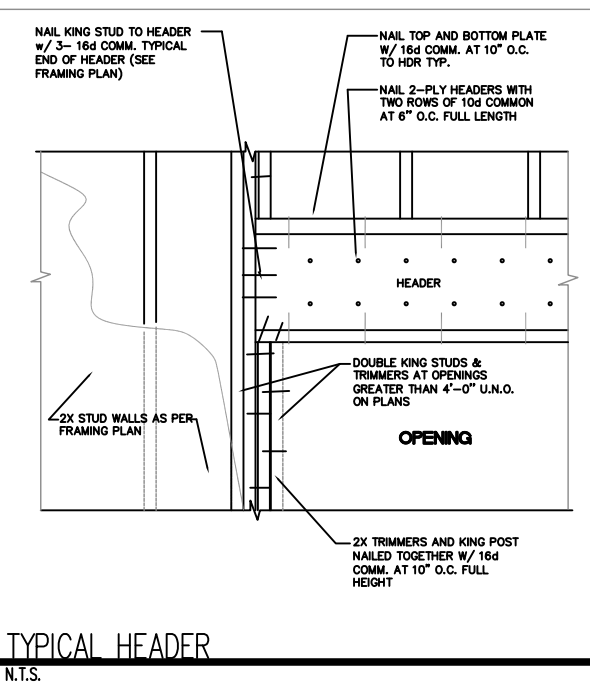

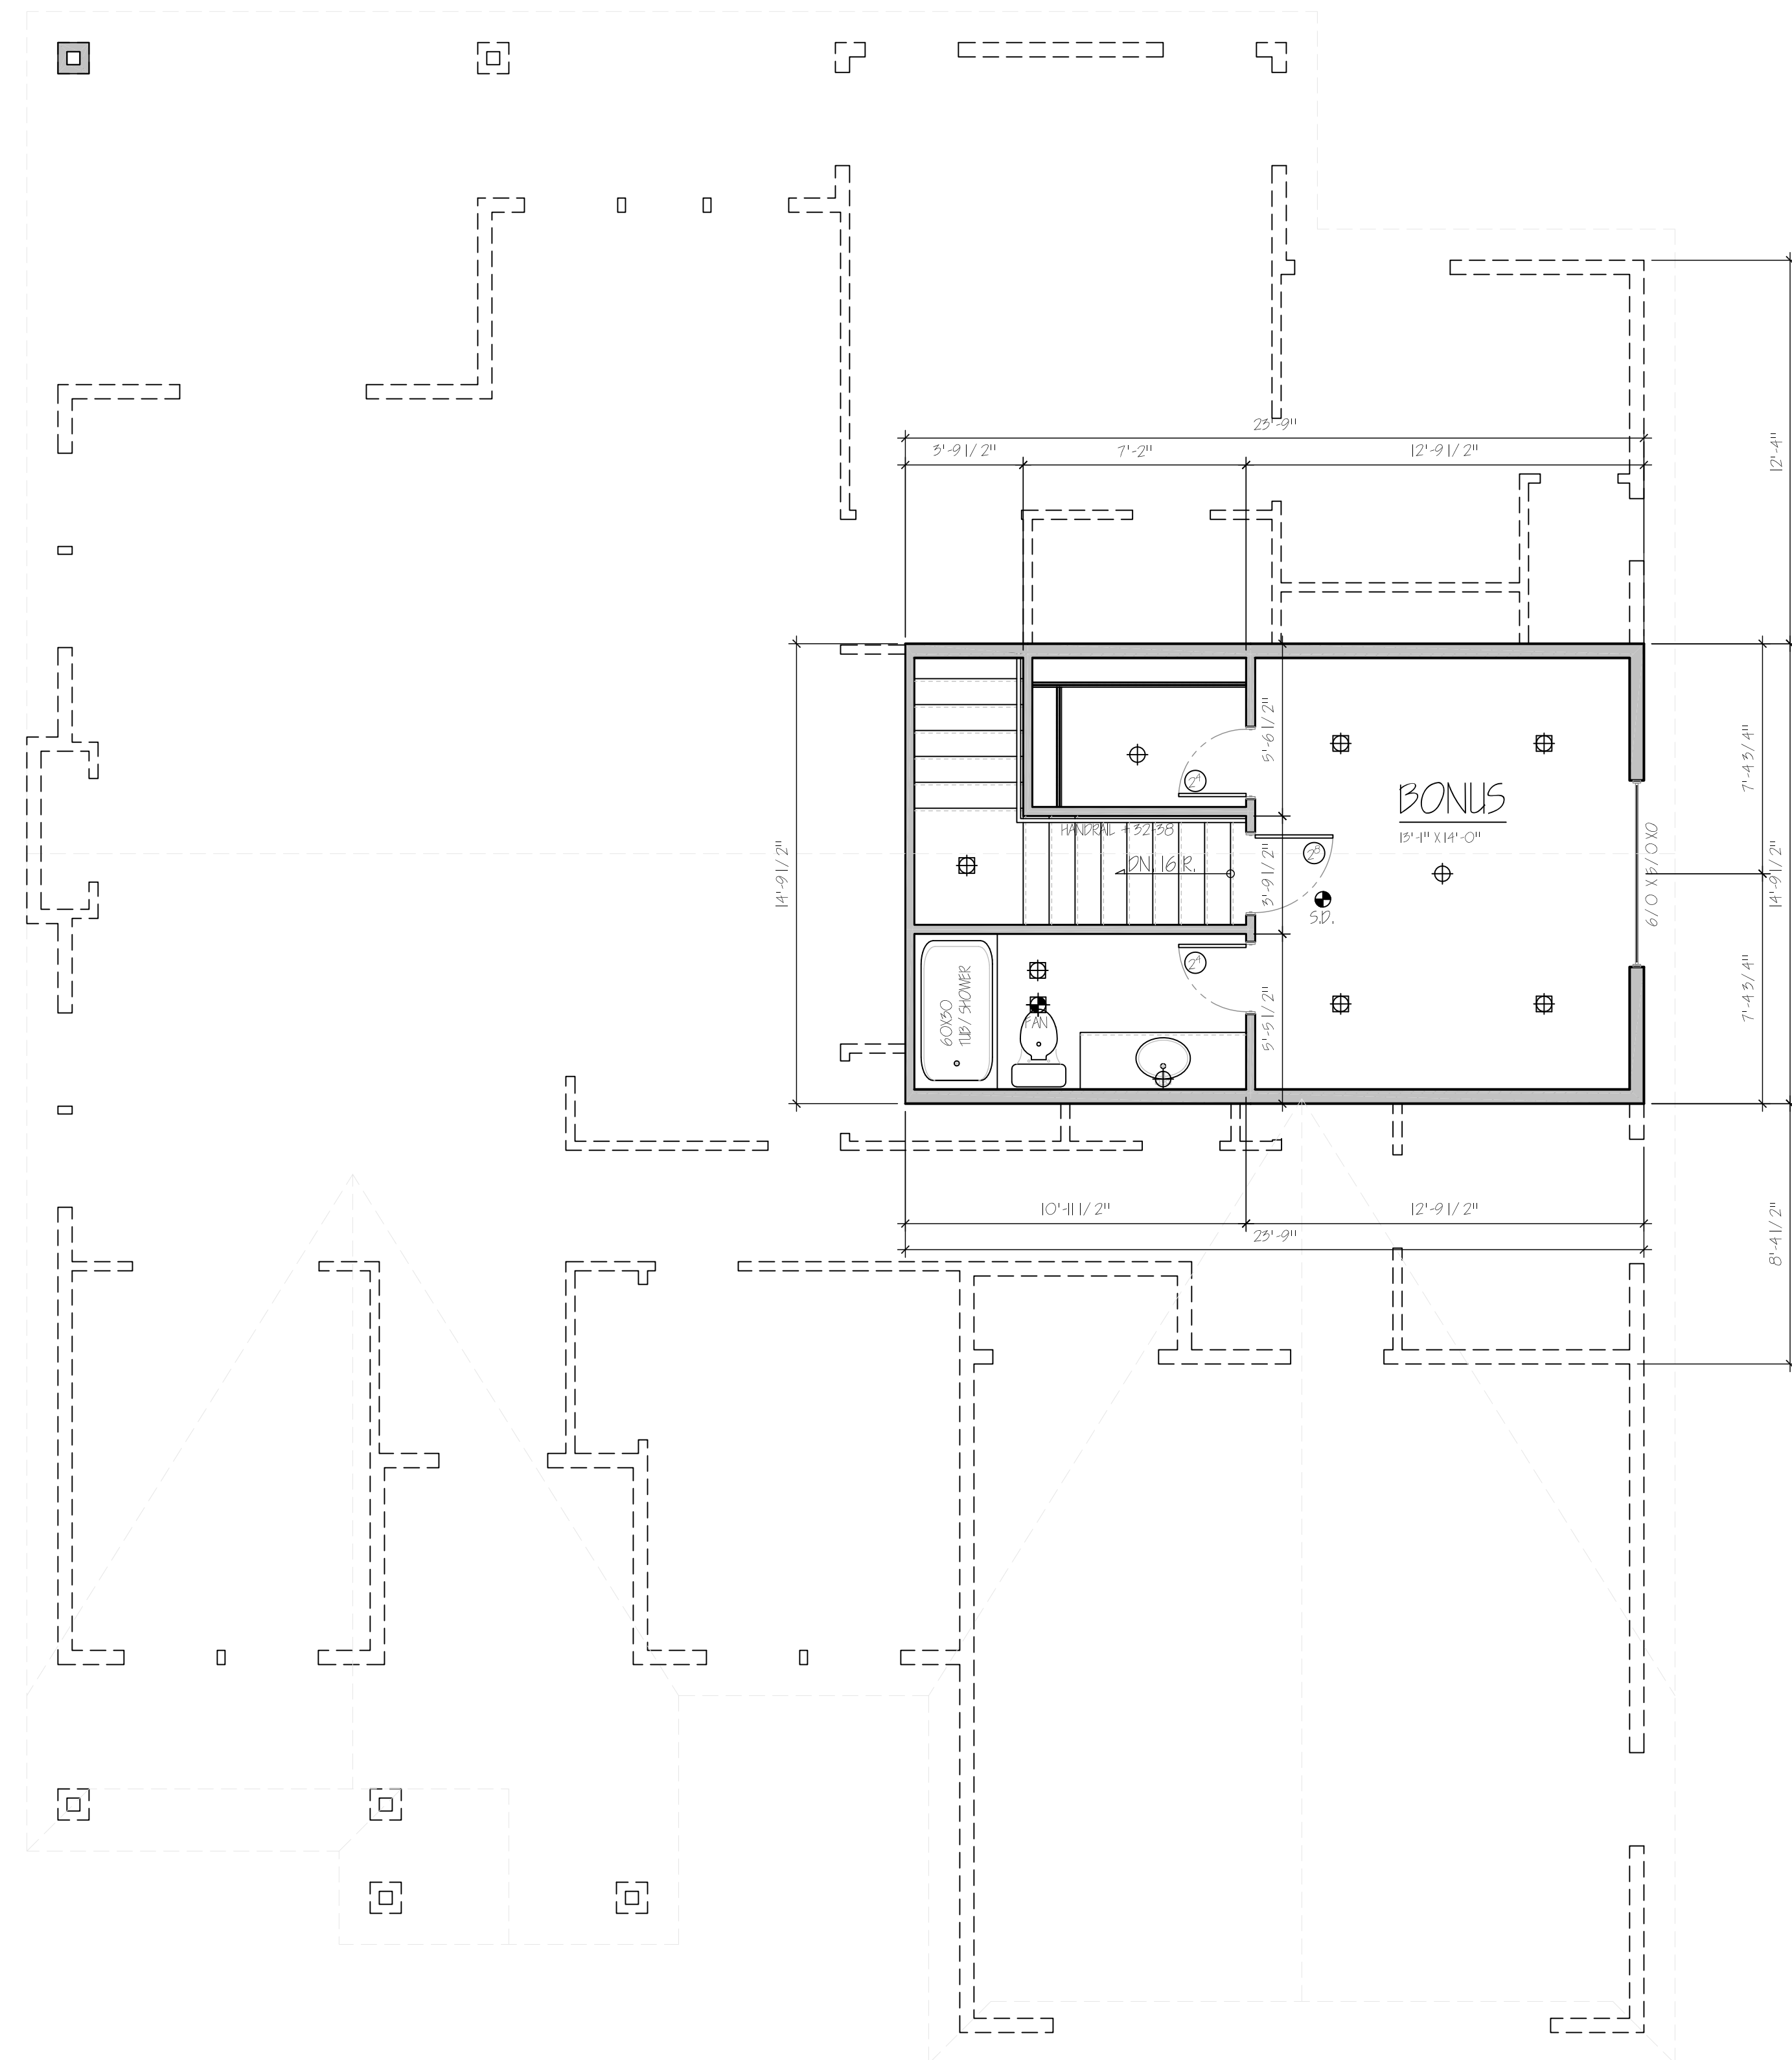

UPPER FLOOR AREA - 346 SQ.FT.
UPPER FLOOR PL

